



Evergy, Inc.
Transource Energy, Inc.

Facility Interconnection Requirements

Approvals: Katy Onnen \e\
Sr. Manager, Transmission & Distribution Planning

Kayla Messamore \e\
Vice President, Strategy and Long-Term Planning

Prepared by: Long Term Planning
November 14, 2022

Table of Contents

Purpose	3
Definition of Capitalized Terms.....	4
1. General Facility Interconnection Requirements.....	4
1.1. Generator Interconnection Requirements	12
1.2. Transmission Interconnection Requirements.....	15
1.3. End-User Interconnection Requirements.....	18
2. Generator Owner Interconnection Requirements.....	18
3. Transmission Owner Procedures & Notifications	18
3.1. Procedures for Coordinated Studies	19
3.2. Procedures for Notification of Affected Systems.....	19
3.3. Confirm Facility Interconnections within BA.....	20
4. Generator Owner Procedures & Notifications	20
4.1. Procedure for Coordinated Study of Customer Facility Interconnections.....	20
4.2. Procedure to Notify Affected Systems	21
4.3. Confirm Customer Facility Interconnections within BA.....	21
Appendix A - Table of Codes and Standards Incorporated by Reference.....	22
Appendix B - Document History	24
Form A - GENERATION INTERCONNECTION APPLICATION	25
Form B - GENERATION INTERCONNECTION APPLICATION.....	28
Attachment A - Relay Standards for Interconnected Generating Facilities	Error! Bookmark not defined.
Attachment B - Relay Standards for Interconnected Load Facilities.....	Error! Bookmark not defined.
Attachment C - Phasor Measurement Units Specifications.....	36
Attachment D - Generator Interconnection Data Requirements for Synchronous Machines.....	37
Attachment E - Generator Interconnection Data Requirements for A-Synchronous Machines..	50

Purpose

This Document was developed to comply with the North American Electric Reliability Corporation (NERC) Reliability Standard FAC-001 Facility Interconnection Requirements.

Facility interconnection and performance requirements are established to avoid adverse impacts on the reliability of the bulk electric system. These requirements address interconnection requirements for Generation facilities, Transmission facilities, and End-User facilities desiring to interconnect to facilities owned by Transource Energy (Transource) and Evergy, Inc., including its operating companies Evergy Kansas Central (EKC), Evergy Metro (EM), and Evergy Missouri West (EMW). For ease of use, the initial numbered section headings in this document align with the requirement numbers in the FAC-001 Standard.

Additional numbered sections provide specific interconnections requirement details for Transource, EKC, EM and EMW. Throughout this document, the term “Companies” shall apply to Evergy and Transource collectively.

Except in cases where specifically delineated, the requirements within the document are applicable to Generation facility, Transmission facility, and End-User facility interconnections.

This Document covers the requirements for interconnection to the Companies’ bulk electric systems in Missouri and Kansas.

Requests for interconnection to the distribution system are addressed in documentation that is available on the Evergy web site at www.evergy.com.

Companies are members of the Southwest Power Pool, Inc. (SPP). SPP functions as Transmission Service Provider and Planning Coordinator for Companies. The primary responsibility for the interconnection process for generation and transmission is with SPP, with Companies as active participants in the process. The primary responsibility for the interconnection process for End-User facilities is with Companies. The SPP Open Access Transmission Tariff (OATT) and Planning Criteria documents address the interconnection process, planning study requirements, and facility interconnection requirements specific to the SPP transmission system. The SPP OATT and Planning Criteria can be accessed via the SPP website at www.spp.org. Interconnection Customers should review the SPP documents for specific SPP interconnection requirements and processes.

This Document is intended to highlight Companies requirements and not to fully replicate or replace the SPP documentation. In addition, the SPP OATT provides the Interconnection Agreement (IA) that is utilized by Companies and includes several interconnection requirements. It is expected that all generation and transmission interconnection requests are directed to SPP.

References to NERC Reliability Standards are made throughout this Document. The referenced NERC Reliability Standards can be found at <http://www.nerc.com/>.

All interconnections to Companies transmission system must be alternating current (AC) at a nominal frequency of 60 hertz (Hz). For Companies, transmission facilities are defined as those electrical facilities operating at 60 kilovolts (kV) or higher. Nominal transmission voltages used by Companies are 345kV, 230kV, 161kV, 138kV, 115kV, and 69kV.

This Document is reviewed and updated as needed. It will be approved by the Senior Manager of Transmission & Distribution Planning and the Vice President of Strategy and Long-Term Planning. It will be publicly posted to the Evergy OASIS websites and provided on the Evergy corporate website.

Definition of Capitalized Terms

Capitalized terms used in this Document will follow the definitions in the NERC Glossary of Terms first, the SPP Tariff second, or as defined below, third.

Companies: Companies shall mean Evergy and Transource Energy.

Customer: Customer shall mean a person or entity responsible for ownership, operation and maintenance of facilities interconnected with Companies' facilities.

Distribution: Distribution shall mean Companies' facilities less than 60 kV (phase to phase voltage).

Document: Document shall mean this Facility Interconnection Requirements document.

End-user: End-user shall mean a retail customer of Companies connecting to the bulk electric system of Companies. End-user facilities shall comply with all provisions of General Facility Interconnection Requirements and all provisions of Transmission Facilities Interconnection Requirements. For purposes of Standard FAC-001-3, Evergy as Distribution Provider shall also comply as an End-user.

Facility Interconnection: Facility Interconnection shall mean the point where Companies and Customer's facilities physically meet.

Generating Source: A Generating Source is defined to exist when ANY of the following conditions are met:

- A. Customer's facilities can produce sustained watt or var flow into Companies' facilities at the closed Facility Interconnection.
- B. Customer's facilities can energize Companies' facilities across the Facility Interconnection at sustained levels of fifty-one (51) volts or more during times when the Companies' source is de-energized.
- C. Customer's facilities can energize the Facility Interconnection with sustained voltage magnitude and frequency quantities, which differ from Companies values.
- D. Customer's facilities can contribute sustained fault-current to Companies' facilities at the Facility Interconnection.

Note: Sustained shall mean to be more than one (1) second duration.

1. General Facility Interconnection Requirements

Facility Interconnection with Companies' bulk electric system facilities may be permitted provided such interconnection complies with the procedures and requirements set forth herein.

Interconnection of Customer facilities with Companies' facilities shall be governed by all applicable Local, State, and Federal statutes. In addition, Customer's facilities shall be installed in accordance with all provisions set forth in Companies' Facility Interconnection Requirements, Evergy's Service Standard, National Electrical Safety Code (ANSIC2), National Electrical Code (NFPA70), North American Electric Reliability Corporation (NERC) Reliability Standards, Regional Reliability Organization, American National Standards Institute (ANSI), Institute of Electrical and Electronics Engineers (IEEE), or other Regulatory

Evergy Facility Interconnection Requirements
or Governing Body having jurisdiction. Interconnection of Customer's facilities with Companies' facilities shall further be governed by any applicable statute, rule, order, provision, guide, or code of an organization, council, and institute, regulatory or governing body having jurisdiction over such matters.

Customer shall be responsible for all engineering studies, design, modeling data, and installation, required for interconnection with Companies' facilities. System studies shall be completed through the Long-term Planning horizon.

Generation interconnection shall be subject to Attachment V of the SPP Tariff. Transmission interconnection shall be subject to SPP Planning Criteria. End-User load additions/modifications shall be subject to Attachment AQ of the SPP Tariff.

Customer shall be responsible for compliance with all permits, licenses, fees, rules, regulations, standards, agreements, ordinances, inspections, and other requirements imposed by Companies or any regulatory or governmental body having jurisdiction. There is no obligation on the part of the Companies to interconnect, or to remain interconnected when Customer's facilities are out of compliance. In addition, Customer shall be responsible for and Companies shall require Customer facilities or the interconnection between Customer's facilities and Companies' facilities to be modified in accordance with all applicable statutes, rules, orders, provisions, guides, or codes of an organization, council, institute, regulatory or governing body having jurisdiction over such matters.

Because of increased risks and potential hazards inherent with operating Customer's facilities interconnected with Companies' facilities, overall safety for life, quality of service and property is paramount. Companies shall disconnect Customer's facilities anytime Customer's facilities pose a dangerous condition, and such disconnection is appropriate to protect safety of Companies' employees, customers, general public, or to maintain integrity of the Companies' facilities.

Customer should be aware that under certain circumstances it may be possible for damage to occur to Customer's rotating equipment. This vulnerability to possible equipment damage includes aurora or a nearby fault on the system. Customer shall review Customer's equipment for potential susceptibility.

Customer shall provide Companies a minimum, unless otherwise agreed to by the Companies, of one hundred and twenty (120) days written notice of its intent to interconnect facilities with the Companies' system. Failure to give such notice shall render Customer liable for all damages to Companies property, other customers' property, and injury to persons, or any other damages resulting from unauthorized interconnection.

Notice of intent to interconnect by the Customer shall be made by providing the appropriately completed Interconnection Application to the Companies as detailed in Forms A (inverter-based generation up to and including 25 KW) or B (non-inverter based generation and inverter-based generation >25kW) of this document.

Requests to install a Facility interconnection shall be submitted by mail or email to:

Evergy
Retail Services:

Evergy
Energy Solutions
P.O. Box 418679
Kansas City, MO 64105
816-242-5971

Facility Interconnection Requirements
Wholesale Services:

Evergy
Sr. Manager, T&D Planning
P.O. Box 418679
Kansas City, MO 64105
longtermplanning@evergy.com

Within thirty (30) days of submitting a written request to interconnect facilities, but not less than ninety (90) days prior to facility interconnection, the Companies shall submit to Customer preliminary general equipment requirements such as breaker(s), switches, supervisory control and data acquisition (SCADA), and existing Companies facility protection scheme, required for Customer to proceed with Facility interconnection design. In addition, Companies shall notify Customer of costs to evaluate the proposed Facility Interconnection.

Within sixty (60) days of receipt of a complete copy of Customer's detailed engineering studies, design specifications, proposed protective relaying schemes, and payment of costs for evaluation, Companies shall review, perform analysis, and notify Customer of approval and/or conditions for acceptance. The engineering analysis shall include a review/evaluation of the following (as applicable):

- A. After the customer supplies SPP and Companies with the approximate geographic location and the desired megawatt (MW) and megavolt-amp reactive (MVAR) capacities at the point of interconnection, SPP and Companies will exercise engineering judgment and the results of engineering studies to determine appropriate voltage levels, interconnection points, and system capabilities for the point of interconnection, since the most practical voltage and interconnection points are site and project specific.
- B. Breaker duty – All facilities and equipment must equal or exceed the fault duty capability necessary to meet system short-circuit requirements as determined through short-circuit analyses and should fully comply with the latest American National Standards Institute (ANSI)/Institute for Electrical and Electronics Engineers (IEEE) C37 collection of standards for circuit breakers, switchgear, substations, and fuses. To maintain reliability, each fault-interrupting device must be rated for full fault-interrupting capability to satisfy the short-circuit level requirements at the point of interconnection. Full fault-interrupting capability is per the latest IEEE C37 and C57 collections of standards. Generally, neither party should depend on the other for the protection of their respective equipment.
- C. Insulation coordination - Insulation coordination must be done properly to ensure electric system reliability and personnel safety. Basic switching surge levels, surge arrester, conductor spacing and gap application, substation and transmission line insulation strength, protection, and shielding shall be documented and submitted for evaluation as part of the interconnection plan.
 - Interconnection facilities to be constructed in areas with salt spray contamination or other type of contamination shall be properly designed to meet or exceed the performance of facilities not in a contamination area with regard to contamination caused outages.
 - Equipment basic impulse surge levels (BIL) shielding and surge protection shall be designed to meet the latest IEEE C62 standards, along with Companies standards. Surge Protection shall be installed to ensure that damage to Companies

or to Customer resulting from transient disturbances is minimized to the extent practical. Surge protection shall conform to NESC Section 19, Section 124A, and Section 171 as applicable.

- D. System protection and coordination – Protective relaying systems and associated communications systems for all facility interconnections shall be planned, designed, constructed, and maintained in accordance with applicable NERC, SPP, and Companies standards. Utility grade protective relays and fault clearing systems are to be provided on the interconnected power system. All protective relays shall meet or exceed ANSI/IEEE Standard C37.90.
- Adjoining power systems may share a common zone of protection between two parties. The design must provide coordination of speed and sensitivity to maintain power system security, stability, and reliability.
 - The protection system (protective relays, associated communication systems, voltage and current sensing devices, station batteries and DC control circuitry) arrangement selected by the Customer must be compatible with the protections system used by Companies to protect the transmission grid. Compatible relaying equipment must be used for a given zone of protection. Compatibility includes protection application, redundancy, operating speed, communication type, and communication medium.
 - The protection system (protective relays, associated communication systems, voltage and current sensing devices, station batteries and DC control circuitry) arrangement selected by the Customer must be compatible with the protections system used by Companies to protect the transmission grid. Compatible relaying equipment must be used for a given zone of protection. Compatibility includes protection application, redundancy, operating speed, communication type, and communication medium.
 - A power source for tripping and control must be provided for the protection system by a DC storage battery. The battery is to be sized with enough capacity to operate all tripping devices after eight hours without a charger, per IEEE standards. An under-voltage alarm must be provided for remote monitoring by the facilities owners, who shall take immediate action to restore power to the protective equipment.
 - Mechanical and electrical logic and interlocking mechanisms are required between interconnected facilities to ensure safe and reliable operation. These include, but are not limited to, breaker and switch auxiliary contacts, synch-check relays, and physical locking devices.
 - The Customer (generator, transmission, end-user) is responsible for providing a protection system that will protect its equipment against disturbances on Companies system and minimize the effects of disturbances from its facilities on Companies equipment and transmission system. Entities connecting to the Companies transmission system shall investigate and keep a log of all protective relay actions and mis-operations, as required by NERC and SPP. In addition, the interconnecting entities must have a maintenance program for their protection systems in accordance with NERC Reliability Standards. Documentation of the protection maintenance program shall be supplied to Companies, SPP, and NERC upon request. As outlined in the maintenance program, test reports are to be

made available for review by Companies. At intervals described in the documented maintenance program and following any apparent malfunction of the protection equipment, the Interconnecting Customer shall perform both calibration and functional trip tests of its protection equipment as outlined by NERC.

- Generator Protection Requirements
 - Generators interconnecting to the Companies transmission system are responsible for protecting those facilities from electrical faults and other hazardous conditions.
 - Generator interconnections must be equipped with circuit breakers or other appropriate interrupting devices to protect those facilities. The generator owner is required to provide and own the primary circuit breaker or other interrupting device that protects the facility and disconnects it from the Companies transmission system. The primary purpose of this interrupting device is to protect the generating plant facility. GI is required to follow IEEE standard C37.102 for generator relay settings.
 - Synchronous or wind turbine generators connected to the Companies transmission system shall be able to withstand certain temporary excursions in voltage, frequency, and reactive and real power output without tripping. A System Impact Study will determine if the generator will trip during temporary excursions. Generation must ride through temporary excursions to support the grid and avoid cascading events.
 - It is recognized that certain circumstances may exist that necessitate the imposition of performance criteria that is considered more stringent than the default criteria specified above. Such circumstances shall be identified during the conduct of the System Impact Study or operational study for each particular generator.
- Transmission Protection Requirements
 - All transmission power systems shall have a dual protective relaying scheme that provides both primary and backup coverage of the remote bus. Communications-aided tripping using a dedicated communications channel may be required based on system stability determination. Communications redundancy may be required depending on critical clearing time. A transfer trip may be required for backup protection and islanding schemes. Transfer Trip is required to follow IEEE standard C37.113 for transmission line relay settings.
 - Backup protective systems should provide additional coverage for breaker and relay failure outside the primary zone. Backup systems shall operate for failures on either side of an interconnection point. Time and sensitivity coordination must be maintained to prevent mis-operations.
 - Fiber optics is the preferred means of relay communications; however, microwave and power line carrier may also be used for relay communications. Audio tone over phone line is the least preferred method because it may not meet requirements for speed and reliability.
 - When new transmission line construction is involved and two high speed protection schemes are used that require communications, two separate OPGW shall be installed for use as the communications means.
 - Each fault-interrupting device must be rated for full fault-interrupting

capability to satisfy the short-circuit level requirements at the point of interconnection. Neither party shall depend on the other for the protection of their respective equipment. All protective devices shall coordinate as described in Attachment A or Attachment B of this Standard depending upon the type of interconnection.

- E. Metering and telecommunication requirements – Metered data shall be telemetered to a location designated by SPP and location as designated by Companies unless alternate satisfactory telemetered locations are agreed to by the Companies and Interconnection Customer.
- Interconnecting Customers that will be a market participant shall install metering that shall be of sufficient quality to meet the requirements as defined by SPP OATT.
 - For interconnections in the state of Kansas, Interconnection Customer may be required to take service for auxiliary use/station power from the local retail electric service provider.
 - Revenue Metering Guidelines
 - For the purposes of this document, revenue metering shall refer to the meter or meters used for billing purposes and the associated current transformers and potential transformers (collectively known as “instrument transformers”), communications equipment, and wiring between these devices. The basic configuration consists of directional revenue grade metering (import and export) at each point of interconnection with the Companies system. Additional separate revenue metering for the gross output of the generation and for auxiliary retail loads may be required, depending on the generation capacity, telemetry requirements, applicable contractual provisions and associated tariffs. All generation and auxiliary retail load metering shall have the ability to connect to an Automated Meter Reading (AMR) system.
 - Before the purchase or fabrication of revenue metering equipment, four sets of each of the following information is required to be submitted to Companies for review and acceptance:
 - Overall Electrical Single-Line Drawing, showing location of revenue metering equipment.
 - Switchgear Single-Line Drawing, showing location of revenue metering transformer compartment.
 - Physical Metering Transformer Compartment drawing, showing the layout of revenue metering current transformers and potential transformers.
 - If the installation utilizes a stand-alone current transformer cabinet, the manufacturer’s drawing, showing the catalog number and address at which its use is intended.
 - Estimated generation capacity and auxiliary retail loads.
 - Companies shall install, calibrate, test, and maintain revenue quality metering in accordance with applicable ANSI Standard C12. Interconnections for Wholesale Service shall utilize revenue quality metering in accordance with applicable ANSI Standard C12, Form B of the Southwest Power Pool Market Protocols and all

such data shall be telemetered to the Transmission Customer or Distribution Service Provider as applicable.

- F. The ratings of Customer’s facilities connecting at 60 kV or higher voltage shall be determined in accordance with SPP Planning Criteria and provided to Companies for verification. Companies’ facilities are rated according to the applicable Facility Rating Methodology posted on OASIS.
- G. Phasor Measurement Unit requirements - Companies shall review the PMU design. See Attachment C for PMU specs.

Should Companies be unable to evaluate Customer’s request to interconnect as submitted, Companies shall provide Customer a written explanation of information required to complete the evaluation.

Grounding and safety issues – All new interconnecting Facilities shall strictly adhere to established Companies switching, tagging and grounding procedures as required for the safety of people and equipment. Any work carried out within a facility shall be performed in accordance with all applicable laws, rules, and regulations and in compliance with Occupational Safety and Health Administration (OSHA), National Electric Safety Code (NESC) and good utility practice. The interconnecting facility ground grid shall, where applicable, be designed to IEEE 80 - “IEEE Guide for Safety in AC Substation Grounding”, and shall be measured in accordance with IEEE 81 - “Part 1: Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Potentials” and Part 2: “Measurement of Impedance and Safety Characteristics of Large, Extended or Interconnected Grounding Systems”. Interconnection Facility grounding requirements shall also comply with the NESC Section 9 “Grounding Methods, and, where appropriate, IEEE 665 - “Guide for Generating Station Grounding”, IEEE 837 - “Standard for Qualifying Permanent Connections Used in Substation Grounding”, IEEE 487 - “Protection of Wire-Line Communication Serving Electric Power Stations”, IEEE 367 - “IEEE Recommended Practice for Determining the Electric Power Station Ground”. This grid shall also limit the ground potential gradients to such voltage and current levels that will not endanger the safety of people or damage equipment which are within, or immediately adjacent to, the station under normal and fault conditions. All transmission line structures shall be adequately bonded and grounded to control step and touch potential in compliance with the NESC, and shall provide adequate lightning protection performance. Customer shall obtain ground resistance measurements using procedures specified by IEEE 81 and shall submit information to Companies for review and verification.

Power Quality impacts – At no time shall the operation of the Interconnecting Customer facility, including associated generators or any of their auxiliary devices as applicable, result in an electrical output in which harmonic distortion exceeds the recommended limits contained in IEEE Standard 519, which defines voltage waveform and harmonic content. Planning Level indices for voltage flicker will be governed by IEEE Standard 1453. Companies criteria for voltage flicker and harmonic distortion at 161kV, 138kV, 115kV, or 69kV bus must meet the following criteria.

Flicker level (short term)	$Pst95\% \leq 0.8$
Flicker level (long term)	$Plt95\% \leq 0.6$
Total harmonic voltage distortion	$THVD \leq 2.5 \%$

Evergy	Facility Interconnection Requirements
Individual harmonic voltage level	$\leq 1.5 \%$
Inductive power factor, monthly average	$\cos \phi \geq 0.98$
Voltage fluctuation	$\Delta U \leq 1.0 \%$

Only written notice shall constitute acceptance by Companies. Written approval by Companies does not waive any requirements pertaining to Customer's installation which may be governed directly by other jurisdictional bodies.

Companies' specifications and requirements are designed towards protecting the safety of life, quality of service and the Companies' property, and do not assume nor ensure proper protection of Customer's facilities equipment during electrical fault.

When Companies are required to incur expenses necessary to make extensions or improvements of its lines or additions to its disconnecting devices, transformers, meters, breakers, relays, controls, data systems, or to make any other equipment modifications relating to its circuits, substations, or apparatus necessary to connect Customer's facilities, and such expenses made are attributable to this application, then all costs incurred by Companies for Facility Interconnection shall be borne by Customer as set forth in the interconnection agreement.

If improvements or upgrades to the Companies' system are necessary to allow for the Customer's interconnection, whether directly related to or as a result of the interconnection, the improvements must be completed prior to interconnection. However, the Companies may approve a temporary operating procedure for use while planned improvements or upgrades to the Companies' system are constructed. For generation interconnection, these operating procedures will be defined in a Limited Operation Interconnection Agreement according to the SPP Tariff. Operating procedures will not be permitted to take the place of necessary system improvements.

When improvements or upgrades to the Companies' system are necessary to allow for the Customer's interconnection, the Companies shall use their standard design and equipment for those improvements and upgrades.

Customer and Companies shall execute appropriate agreements for interconnected service prior to installation of any equipment. Energy supplied to Companies, as well as energy used by Customer, shall be compensated in accordance with applicable tariffs, rules, and regulations currently on file with the regulatory body having jurisdiction, or which may be filed and approved by the regulatory body having jurisdiction.

Companies may require Customer's facility design to include an appropriate automatic disconnecting device to be controlled by any or all of the following: overcurrent relays, automatic synchronizing relays, voltage relays, frequency relays, ground fault detection relays, or any other automatic relaying equipment necessary to ensure proper protection and safety of Company employees, customers, equipment, and overall system integrity. The Companies reserve the right to review, inspect, and approve Customer's design and shall not give approval to connect until any concerns relating to Customer's design has been remedied. Refer to Attachment A, "Relay Standard for Connected Generating Facilities", and Attachment B, "Relay Standard for Connected Load Facilities" for assistance in fulfilling the requirements of this paragraph.

Companies shall procure, install, and maintain all metering equipment required to measure energy exchanged between Customer and Companies across the Facility Interconnection, unless otherwise agreed to by Companies. Energy shall normally be measured at delivery voltage; however, Companies reserve the right to locate its metering at a place other than the Facility Interconnection and adjust for losses as appropriate.

1.1. Generator Interconnection Requirements

The Customer that is requesting a Generating Source Interconnection (GI) that may inject current on to the Companies transmission system must follow the Generator Interconnection Procedures of Attachment V of the Southwest Power Pool Open Access Transmission Tariff.

Companies functional relay requirements will be provided to the Customer during the detailed design phase of the project. The information for the specific project will indicate the protective functions for which the Customer is to provide relays and related equipment.

The Customer will indicate the specific relay type(s) and range proposed for each function.

The Customer must also provide proposed current and potential transformer ratios, connections, and locations as related to the electrical one-line diagram.

Customer design documents (electrical prints, relay settings, etc.) will be reviewed by Companies in coordination with SPP. Project delays due to untimely submittal of complete design documents are the responsibility of the GI. These must be of good engineering quality and include the following:

- One-line diagram showing the interconnections between the generator(s) and the Company system
- Three-line diagrams showing current and potential circuits for protective relays
- Relay tripping and control schematic diagram
- Relay setting files
- Instruction books for relays
- Completed Form A or Form B of this Document as applicable

Additional engineering meetings may be necessary to discuss the design documents. If changes are necessary, the Customer is required to incorporate all changes and corrections and submit three sets of corrected prints to Companies before proceeding with construction.

1.1.1 General Requirements for interconnection of Generating Sources

1.1.1.1. Generating Source(s) 25 kW and larger shall be three (3) phase to qualify for Facility Interconnection with Companies facilities.

1.1.1.2. Generating Source(s) shall not supply sustained fault current to Companies' facilities.

1.1.1.3. Generating Source(s) shall not close or reclose automatically onto a de-energized Companies Facility Interconnection.

1.1.1.4. Disconnecting equipment shall have a visible break between Customer and Companies facilities for connections 600 volts and above.

1.1.1.5. Companies shall determine the acceptable minimum aggregate power factor at Facility Interconnection. Appropriate billings, payments, or adjustments to compensate Companies shall be specified in the Facility Interconnection agreement.

1.1.1.6. Customer Standby or Emergency Generating Sources will require

no special relaying or metering when installation is designed to prevent “hot transfer of Customer’s load” going “on” or “off” from the Standby source to the Companies’ facilities, provided all requirements can be handled with control circuit interlocks.

- 1.1.1.7. Supervisory Control and Data Acquisition (SCADA) may be required by Companies to connect Generating Source(s) to Companies facilities.
- 1.1.1.8. Generating sources that participate in the Southwest Power Pool Energy Imbalance Market shall install metering and telecommunications equipment compliant with Form B of the Southwest Power Pool Market Protocols.
- 1.1.1.9. Any electrical structure or equipment utilized for high-voltage service shall be connected to an earth-ground grid that measures no more than 0.6 ohms resistance to earth. Such value shall be measured with equipment and techniques approved by the Companies and shall be certified by a measuring contractor qualified for this service. The connectors and components of the grounding grid shall be adequate for the anticipated short-circuit current magnitude and duration.
- 1.1.1.10. Generating sources requesting Wholesale Service shall comply with the Southwest Power Pool Attachment V of the Regional Open Access Transmission Tariff.
- 1.1.1.11. In instances where the Customer installs PMU equipment, it shall be designed to the specifications as described in Appendix C.
- 1.1.2. Synchronous Generating Source(s) shall utilize three-phase circuit breakers that meet or exceed the following requirements:
 - 1.1.2.1. Rated for 2.0 per unit voltage across open contacts.
 - 1.1.2.2. Interrupt maximum available fault currents between Customer’s Generating Source(s) and Companies’ facilities.
 - 1.1.2.3. Open for frequency and voltage deviations specified by Companies.
 - 1.1.2.4. Utilize synchronism check within +/- 10 degrees and +/- 5 percent of nominal voltage on each side of the breaker prior to closing the breaker between Companies and Customer’s facilities.
 - 1.1.2.5. Provide ground fault detection and tripping for breaker anytime an ungrounded circuit configuration exists as the result of opening the Companies’ source to the Facility Interconnection.
 - 1.1.2.6. Continuously monitor breaker control power source.
- 1.1.3. Induction Generating Source(s) shall utilize three-phase circuit breakers that meet or exceed the following requirements:
 - 1.1.3.1. Companies shall specify frequency and voltage deviations to Customer for which circuit breaker shall open.

- 1.1.3.2. Breaker control power source shall be continuously monitored.
- 1.1.4. Generating Source(s) Facility Interconnections - 5000 kVA and Greater
 - 1.1.4.1. Generating Source(s) shall operate with excitation systems in automatic voltage-control mode.
 - 1.1.4.2. Generating Source(s) shall maintain reactive power output as required by the Companies within the demonstrated reactive capability of the unit.
 - 1.1.4.3. Generating Source(s) shall be capable of operation at over-excitation power factor of 0.9 and under-excitation power factor of 0.95 at all rated continuous power output levels as measured at the generator terminals.
 - 1.1.4.4. In addition to the protection described in 6.15, Generating Source(s) shall include current differential protection around the generator and/or the generator step-up transformation as well as protective functions designed for the specific type of generator. For example, protection for rotating generators shall include reverse power, loss of field, negative sequence current, and inadvertent energization. Refer to IEEE C37.102 – “IEEE Guide for AC Generator Protection.”
- 1.1.5. Generating Source(s) Facility Interconnections – Distribution
 - 1.1.5.1. Customer shall protect Generating Source(s) from the effects of automatic reclosing of Companies facilities.
 - 1.1.5.2. No distribution circuit shall have greater than 10% of its rated capacity as installed generation unless otherwise approved by Companies.
 - 1.1.5.3. Where network protectors (in lieu of circuit breakers), are utilized by Companies, Customer shall not inject power onto Companies’ system.
- 1.1.6. Transitional Switching of Generating Source(s)
 - 1.1.6.1. Customer may be permitted to utilize approved methods of transitional switching for the purpose of making a synchronize transfer of Customer’s load between Customer’s Generating Source(s) and Companies’ facilities. Such transitional switching shall require automatic synchronizing equipment and high-speed switching devices specifically designed to synchronize Customer’s Generating Source(s) to the Companies for the sole purpose of “hot” transferring the Customer’s load “On” or “Off” the Companies’ facilities.
 - 1.1.6.2. All Customer requests for transitional switching shall be approved by Company and accomplished in such a manner as not to exceed one half (0.5) second as the maximum time Customer’s Generating Source(s) operates connected with Companies’ facilities.

- 1.1.6.3. Customer shall be responsible for all costs associated with transitional switching.
- 1.1.7. Commissioning of Generating Source Interconnection
 - 1.1.7.1. Companies may measure and document the harmonics present at the Facility Interconnection before and after such connection is made.
 - 1.1.7.2. Companies reserve the right, but does not assume the duty, to inspect, test, or check Customer's equipment in any way deemed appropriate to confirm operation and verify system protection characteristics. Companies do not assume any responsibility regarding Customer's equipment or the inspection thereof.
 - 1.1.7.3. Metering equipment shall be verified by Companies or their designated agent.
 - 1.1.7.4. Only after all required inspection or testing is complete shall Generating Source be synchronized to Companies' facilities.
- 1.1.8. Generating Source Operating Requirements
 - 1.1.8.1. Customer agrees to respond to Companies requests during abnormal conditions, including abnormal frequency and abnormal voltage.
 - 1.1.8.2. Customer agrees to coordinate maintenance activities with Companies as defined.
 - 1.1.8.3. Customer shall ensure competent personnel are available to operate, maintain, and repair connected generating equipment at all times when such equipment operates in parallel with Companies' facilities.
 - 1.1.8.4. Companies may require connected generating sources to have both normal and emergency paths for supervisory control, metering, or voice communications systems.
 - 1.1.8.5. Automatic under-frequency load shedding may be required by the Companies. Load serving providers shall be required to provide the Companies with a documented manual load shed plan.
 - 1.1.8.6. Customer shall provide all available operating data upon request.

1.2. Transmission Interconnection Requirements

Companies' electrical facilities include transmission lines operating at voltage levels of 60 kV and higher. Higher voltage levels require stringent standards of security, reliability, quality, and controllability of the electrical facilities.

1.2.1. Transmission Facilities – General Requirements

- 1.2.1.1. Any electrical structure or equipment utilized for high-voltage service shall be connected to an earth-ground grid that measures no more than 0.6 ohms resistance to earth. Such value shall be measured with equipment and techniques approved by the Companies and shall be certified by a measuring

contractor qualified for this service. The connectors and components of the grounding grid shall be adequate for the anticipated short-circuit current magnitude and duration. Transmission facility grounding shall be designed to IEEE 80. Depending upon the application, grounding shall also comply with IEEE 665 - Guide for Generation Station Grounding, IEEE 837 - Standard for Qualifying Permanent Connections Used in Substation Grounding, IEEE 487 - Protection of Wire-Line Communications Serving Electric Power Stations, and IEEE 367 - Recommended Practice for Determining the Electric Power Station Ground.

- 1.2.1.2. Supervisory remote control and electrical metering shall be provided using devices and communications paths specified by the Companies. Such equipment shall be proven operational before electrical operation begins.
- 1.2.1.3. Maintenance at the Facility Interconnection shall be coordinated with the Companies.
- 1.2.1.4. Customer's interconnection to Companies' Transmission System shall comply with Evergy's BES Planning Criteria on OASIS.
- 1.2.1.5. If the Customer's system is found to be out of compliance with the Evergy BES Planning Criteria, the Customer will repair/upgrade their system or remove the cause of the event.
- 1.2.1.6. Customer's facility will be supplied from Companies' Transmission System and Customer should plan and design their systems to operate at a power factor within the range of 0.98 lagging to 0.98 leading at all times.
- 1.2.1.7. Switched shunt capacitors generally provide an effective means of controlling the power factor of a Customer's facility. Factors to be addressed when applying capacitors include, but are not limited to, transient overvoltages due to capacitor switching and steady state increases in voltage distortion due to resonance conditions. Transient overvoltages shall be limited to less than 130% of nominal zero-to-peak voltage and decay within one 60Hz cycle. Specialized switch types shall be used to mitigate capacitor switching transients. The services of a qualified consultant should be obtained by Customer to review the specific application and provide recommendation in regard to control of these phenomena.
- 1.2.1.8. Certain electrical equipment located at the Customer's facility will generate voltage flicker, notching and / or harmonic distortion that can negatively impact other transmission users. Definitions and limits for current and voltage harmonic distortion are as published in the latest issuance of IEEE 519 - "Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems."
- 1.2.1.9. Companies requires that voltage flicker occurring at Facility Interconnection shall remain below the Border Line of Visibility curve on the

IEEE/GE curve, referenced for example in IEEE 141 - "IEEE Recommended Practice for Electric Power Distribution for Industrial Plants" and IEEE 519, for fluctuations less than 1 per second or greater than 10 per second and shall remain below 0.4 percent in the range 1 to 10 fluctuations per second. Further, Customer may be required to meet specific requirements of the IEEE 1453 - "IEEE Recommended Practice for Measurement and Limits of Voltage Fluctuations and Associated Light Flicker on AC Power Systems" in special cases dictated by Customer's load or generation profile.

- 1.2.1.10. Total Harmonic Voltage Distortion shall be in compliance with IEEE 519.
 - 1.2.1.11. The ratings of Customer's facilities shall be consistent with the requirements of SPP Planning Criteria. The ratings of Customer's facilities shall be provided to Companies upon request.
 - 1.2.1.12. Voltage Unbalance, as calculated using the ANSI C84.1 formula, shall be limited to 1% or less at all times during system normal operation by the Customer.
 - 1.2.1.13. Customer and Companies have the obligation to ensure that Facility Interconnection is configured in such a way to mitigate the probability of a ferroresonance event. Ferroresonance is a complex electrical phenomenon. It occurs on the power system (usually at distribution voltage levels) under certain system configurations that may damage high voltage equipment. Some mitigation measures on the transmission system that will be used are coordinated relay protection, redundant primary relay protection, and installing gang operated switches. The Customer will be knowledgeable of conditions that increase the possibility of ferroresonance as well as procedures and equipment that mitigate and/or lessen the chances for this system condition to occur.
 - 1.2.1.14. Revenue interconnection metering shall not use CCVTs.
 - 1.2.1.15. In instances where the Customer installs PMU equipment, it shall be designed to the specifications as described in Appendix C.
- 1.2.2. Transmission Facilities - 60 kV through 200 kV Requirements
- 1.2.2.1. Multiple remote-controllable line-sectionalizing switches or circuit breakers with protective relays may be required at Facility Interconnection.
 - 1.2.2.2. Transformers capable of serving load greater than 14.0 MVA shall be controlled by a primary circuit-switcher or circuit-breaker with appropriate protective relaying.
 - 1.2.2.3. Structures at the Facility Interconnection may be required to be of steel construction.
 - 1.2.2.4. Sectionalizing devices may require load breaking and/or fault interrupting capability.

- 1.2.2.5. Protective relay schemes of Customer shall be integrated to operate with protective relay schemes on Companies facilities.
 - 1.2.2.6. Protective relaying shall include both primary and backup schemes.
 - 1.2.2.7. The BIL of equipment installed shall conform to the minimum of: 69 kV – 350 kV BIL; 115 kV – 550 kV BIL; 138 kV – 650 kV BIL; and 161 kV – 750 kV BIL.
 - 1.2.2.8. Where a ring-bus or breaker-and-a-half facility is installed, redundant DC supply systems shall be used.
- 1.2.3. Transmission Facilities - 200 kV and Higher Requirements
 - 1.2.3.1. All requirements for lower-voltage transmission facilities shall apply. In addition, the following requirements shall apply:
 - 1.2.3.2. Substation design shall be ring-bus or breaker-and-a-half configuration.
 - 1.2.3.3. Control power shall be supplied from redundant DC supply systems.
 - 1.2.3.4. Protective relaying shall include dual primary schemes.

1.3. End-User Interconnection Requirements

The Customer that is requesting End User Interconnection (EU) is responsible for designing, installing, operating, and maintaining its own equipment in accordance with Good Utility Practice(s), the National Electrical Code, the National Electrical Safety Code (NESC), NERC, SPP, any applicable independent system operator, and all applicable laws and regulations. This includes installing, setting, and maintaining all protective devices necessary to protect the customer's facilities. The requirements specified in this Document are designed to only protect Companies facilities and to maintain transmission system reliability. The EU is responsible to coordinate with Companies during the engineering / detailed design phase of the project in order to ensure coordination of protective relay devices.

End-user facilities shall comply with all provisions of General Facility Interconnection Requirements (Section 1 above) and all provisions of Transmission Facilities Interconnection Requirements (Section 1.2 above).

End-user facilities shall be documented and coordinated by specific System Planning studies, and by studies performed pursuant to Southwest Power Pool Open Access Transmission Tariff – Attachment AQ.

2. Generator Owner Interconnection Requirements

Companies shall maintain and update this Document as required and will make it available upon request within 45 calendar days of full execution of an Agreement to conduct a study on the reliability impact of interconnecting a third-party Facility to the Companies' existing Facility that is used to interconnect to the Transmission System.

3. Transmission Owner Procedures & Notifications

Procedures and Notifications associated with Customer interconnections with

Companies transmission system are detailed in the following sections.

3.1. Procedures for Coordinated Studies

Companies are member of SPP Regional Transmission Organization (RTO). One of the many functions of SPP is to coordinate joint studies of new facilities and their impacts on the interconnected transmission system. Companies actively participates in these processes. The process is described in the SPP OATT which is available on the SPP website.

The impact of the Customer interconnection on the reliability of the interconnected transmission system shall be evaluated. Studies are performed by SPP in conjunction with Companies and in accordance with established NERC, SPP and Companies Transmission Planning Criteria. The SPP OATT includes attachments that define the data requirements for interconnection Feasibility and System Impact Studies. Generators and Transmission Interconnection Customers should refer to the SPP OATT for specifics. Data is to be submitted as provided in the SPP OATT.

Generator Interconnection (GI) requests must proceed through the SPP generator interconnection process. Generator Interconnection Procedures (GIP) are detailed in the SPP OATT Attachment V, Generator Interconnection Procedures Including Generator Interconnection Agreement. Three levels of system studies are defined in the GIP; 1) Feasibility, 2) System Impact, and 3) Facilities. These series of studies are performed to determine the impact of the generator interconnection request on the transmission system. The study results include identification of solutions to any identified reliability violations. The results of these targeted studies are posted to the SPP website.

Transmission interconnections are analyzed as SPP performs annual studies to evaluate transmission system reliability as part of its Integrated Transmission Planning (ITP) process. As part of the evaluation process it may be determined there is a need for additional system reliability support across multiple interconnected transmission owner facilities. Solutions to identified reliability issues are developed by the affected transmission owners in coordination with SPP. The study results and resultant solutions identified are documented in the annual SPP Transmission Expansion Plan (STEP) and posted to the SPP website. Transmission Owner to Transmission Owner interconnections are evaluated in accordance with SPP Planning Criteria.

End-Users looking to interconnect to the Companies transmission system are required to complete a Service & Meter application, available at www.evergy.com. Information such as the type of service requested and load levels expected are captured by the form on the website. End-User interconnection requests are evaluated by Companies to determine if any system reliability impacts may result from the interconnection of the Customer to the transmission system. Studies are primarily conducted to determine if there is available capacity at the interconnection point to accommodate the request. If additional system reinforcements are identified during the study the results will be made known to the EU and solutions will be proposed to address the issue. Load additions will be submitted to SPP to be evaluated as part of the SPP OATT, Attachment AQ, Delivery Point Addition Process.

3.2. Procedures for Notification of Affected Systems

SPP Generator Interconnection Procedures include provisions for notifying affected systems of the reliability impacts of new or modified generator interconnection requests. Companies will adhere to those provisions for notification of affected systems.

For transmission interconnections, Companies will follow the notification requirements of SPP Planning Criteria.

Reliability impacts from End-user interconnections will be identified by SPP through the analysis processes of the Attachment AQ. SPP will communicate any reliability issues to all affected systems.

3.3. Confirm Facility Interconnections within BA

Generation interconnections within the SPP BA are subject to the provisions and procedures established in the SPP OATT, SPP Business Practices, and SPP Planning Criteria. The Companies direct all generation interconnection customers to contact the SPP in order to establish a new or materially modify generator interconnection within the SPP BA. The generation interconnection customer, Transmission Owner, and the SPP negotiate and execute an interconnection agreement prior to the energization of any new generation interconnections. Metering for Generator Interconnections will follow the provisions of Article 7 of the Generator Interconnection Agreement as defined in the SPP OATT.

Transmission interconnections within the SPP BA are subject to the provisions and procedures established in the SPP OATT, SPP Business Practices, and SPP Planning Criteria. The Companies direct all transmission interconnection customers to contact the SPP in order to establish a new or materially modify transmission interconnection within the SPP BA. The transmission interconnection customer, Transmission Owner, and the SPP negotiate and execute an interconnection agreement prior to the energization of any new transmission interconnections. Metering locations will be identified in these interconnection agreements. Meter Agent will ensure that metering data is collected and communicated to SPP and affected systems.

End-user interconnections within the SPP BA are subject to the provisions and procedures established in the SPP OATT, SPP Business Practices, and SPP Planning Criteria. The Companies directs all End-user interconnection customers to contact the SPP in order to establish a new or materially modify end-user interconnection within the SPP BA. The end-user interconnection customer, Transmission Owner, and the SPP follow the process outlined in Attachment AQ of the SPP Tariff prior to the energization of any new end-user interconnections. End-User interconnections for Retail Service shall follow applicable Companies retail service tariff. Companies shall install, calibrate, test, and maintain revenue quality metering in accordance with applicable ANSI Standard C12. Interconnections for Wholesale Service shall utilize revenue quality metering in accordance with applicable ANSI Standard C12, Form B of the Southwest Power Pool Market Protocols and all such data shall be telemetered to the Transmission Owner or Distribution Service Provider as applicable.

4. Generator Owner Procedures & Notifications

Procedures and Notifications associated with Customer interconnections with Companies Generator Owner Facilities are detailed in the following sections.

4.1. Procedure for Coordinated Study of Customer Facility Interconnections

Companies will follow same procedures in Section 3.1 above.

In accordance with the SPP Tariff, if network or distribution upgrades are identified as

needed through the generation interconnection study process, the costs of those upgrades shall be solely funded by the Customer unless the Companies elect to fund the capital for the upgrades.

4.2. Procedure to Notify Affected Systems

Companies will follow same procedures in Section 3.2 above.

4.3. Confirm Customer Facility Interconnections within BA

Companies will follow same procedures in Section 3.3 above.

Appendix A - Table of Codes and Standards Incorporated by Reference

The following Table of Codes and Standards Incorporated by Reference is intended to be informative but not determinative as to all statutes, regulations, standards, and codes that may apply to the interconnection of non-utility generation, transmission, and/or end-use facilities connected to the Companies’ electric system inclusive of distribution or transmission facilities.

For example, it is not practical to list all potential county and city municipal codes. Also, relevant orders and requirements may have more current versions not yet recognized in this table. Companies do not assume any expressed or implied warranty the information is correct and accurate. In the event the table contains errors or omissions, the Interconnecting Customer is not relieved from its duty to comply with all current applicable laws, codes, and standards of all regulatory or governing bodies having jurisdiction.

Citation	Title	Initial FIR Reference Date
Electric Service Standards	Evergy’s Electric Service Standards	04-08-2004
FAC-001-2	NERC Reliability Standard: Facilities Design, Connections, and Maintenance-Facility Connection Requirements	11-15-2013
FAC-002-2	NERC Reliability Standard: Facilities Design, Connections, and Maintenance-Coordination of Plans For New Generation, Transmission, and End-User Facilities	06-28-2012
Good Utility Practice	FERC, Order No. 888, 75 FERC 61,080 (1996); FERC <i>Policy Statement on Matters Related to Bulk Power System Reliability</i> , 107 FERC ¶ 61,052, clarified, 108 FERC ¶ 61,288 (2004), <i>Supplement to Policy Statement On Matters Related to Bulk Power System Reliability</i> , 110 FERC ¶ 61,096 (2005).	04-08-2004
IEEE 1547.7	Standard for Interconnecting Distributed Resources with Electric Power Systems	06-28-2015
IEEE 519	IEEE Recommended Practice and Requirements for Harmonic Control in Electric Power Systems	04-08-2004
IEEE 1453	IEEE Recommended Practice for the Analysis of Fluctuating Installations on Power Systems	09-03-2015
IEEE 80	IEEE Guide for Safety in AC Substation Grounding	04-08-2004
IEEE 81	Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Potentials	11-1-2018
IEEE 141	Recommended Practice for Electric Power Distribution for Industrial Plants	11-1-2018

Citation	Title	Initial FIR Reference Date
IEEE 367	Recommended Practice for Determining the Electric Power Station Ground	11-1-2018
IEEE 487	Protection of Wire-Line Communication Serving Electric Power Stations	11-1-2018
IEEE 665	Guide for Generating Station Grounding	11-1-2018
IEEE 837	Standard for Qualifying Permanent Connections Used in Substation Grounding	11-1-2018
IEEE C37	Institute for Electrical and Electronics Engineers (IEEE) Standard – C37 <i>et seq.</i>	04-08-2004
IEEE C57	IEEE Standard – C57	04-08-2004
IEEE C62	IEEE Standard – C62	04-08-2004
ANSI C12		11-1-2018
ANSI 84.1		11-1-2018
ITP	SPP Integrated Transmission Planning	04-08-2004
NEC	NFPA 70 National Electrical Code	04-08-2004
NESC	National Electrical Safety Code	04-08-2004
OATT	SPP Open Access Transmission Tariff	04-08-2004
OSHA	29 C.F.R. § 1900 <i>et seq.</i>	06-28-2012
SPP Planning Criteria	SPP Planning Criteria and Appendices	04-08-2004
STEP	SPP Transmission Expansion Plan	06-28-2012

Appendix B - Document History

The following table documents changes to this document.

Date	Document	Description
2018-11-1	Evergy Facility Interconnection Requirements 11-1-18.pdf	merged facility connection requirements for KCP&L and Westar
2019-11-1	Evergy Facility Interconnection Requirements 11-1-19.pdf	Annual Review. Updated document approvers, errata changes to align with company integration.
2020-3-4	EVERGY_PL_FAC-001_Facility Interconnection Requirements.pdf	Updated document to clarify that upgrades are required to be completed prior to interconnection, upgrades will use Evergy’s standard design and equipment, and the cost of upgrades are the customer’s responsibility.
2020-7-31	EVERGY_PL_FAC-001_Facility Interconnection Requirements.pdf	Updates Sections 1.D, 1.1.6.2, and 1.2.2.8 to incorporate system protection changes, incorporated Transource Energy, and updated references to Evergy from legacy company names.
2021-12-01	EVERGY_PL_FAC-001_Facility Interconnection Requirements.pdf	Updated Purpose section for document review to be as needed. Updated personnel titles and document dates. Updated formatting of Table of Contents and headings throughout document.
2022-11-14	EVERGY_PL_FAC-001_Facility Interconnection Requirements.pdf	Eliminated references to PRC-001, cleaned up references to SPP Planning Criteria, other general clean-up items.

Form A - GENERATION INTERCONNECTION APPLICATION

(Inverter Based Generation up to and including 25 kW)

Preface: This Facility Interconnection Standard applies to any connection to Companies' electric system regardless of voltage.

This application is complete when it provides all applicable information required below and includes a one-line diagram.

Applicant:

Name: _____

Address: _____

City, State, Zip: _____

Telephone (Day): _____ (Evening): _____

Fax: _____ E-mail Address: _____

Companies Customer Account Number:

Contact (If different from Applicant):

Name: _____

Address: _____

City, State, Zip: _____

Telephone (Day): _____ (Evening): _____

Fax: _____ E-mail Address: _____

Generating Facility:

Location (If different from above): _____

Facility Owner: _____

Inverter Manufacturer/Model: _____

Nameplate Rating (kW, kVA, Voltage, Frequency): _____

Single Phase: _____ Three Phase: _____ (check one)

System Design Capacity: _____ (kW) _____ (kVA)

Prime Mover (Photovoltaic, Turbine, Fuel Cell, Other): _____ (describe)

Energy Source (Solar, Wind, Hydro, Other): _____ (describe)

Is the equipment UL1741 Listed? Yes _____ No _____

If yes, attach evidence of UL1741 listing.

Estimated Installation Date: _____ Estimated In-Service Date: _____

List components of the Interconnection Equipment Package that are certified:

Equipment Type:	Certifying Entity:
1. _____	_____
2. _____	_____
3. _____	_____

Attach a one-line diagram of the Generating Facility

Applicant Signature:

I hereby certify that, to the best of my knowledge, the information provided in this application is true. I agree to abide by the terms and conditions specified in this Interconnection Agreement.

Signed: _____

Title: _____

Date: _

Operation is contingent on Companies Energy’s approval to interconnect the Generating Facility.

Utility Signature:

Interconnection of the Generating Facility is approved contingent upon the terms and conditions specified in this Interconnection Agreement.

Utility Signature: _____

Title: _____

Date: _

Application ID Number: _____

Utility waives inspection/witness test? Yes No

Written applications should be submitted by mail or email:

Retail Services:

Evergy
Energy Solutions
P.O. Box 418679
Kansas City, MO 64105

Wholesale Services:

Evergy
Sr. Manager, T&D Planning
P.O. Box 418679
Kansas City, MO 64105
longtermplanning@evergy.com

Form B - GENERATION INTERCONNECTION APPLICATION

(Non-Inverter Based Generation and Inverter Based Generation > 25 kW)

Preface: This Facility Interconnection Standard applies to any connection to Companies' electric system regardless of voltage

This Application is complete when it provides all applicable and correct information required below and includes a one-line diagram. A load flow data sheet must be supplied with this application.

Additional information to evaluate a request for interconnection may be required after an application is deemed complete.

Applicant requests review under (select one):

Non-Inverter Based Generation Inverter Based Generation > 25kW

1.0 Applicant Information

Legal Name of Applicant (if an individual, individual's full name)

Name: _____

Address: _____

City, State, Zip: _____

Telephone (Day): _____ Telephone (Evening): _____

Fax: _____ E-mail Address: _____

Type of Interconnection (Choose one): Qualified Net Metering
 Load Response (no export)
 Wholesale Provider

Companies Customer Account Number (for Generating Facilities at Owner Locations): _____

2.0 Generating Facilities Specifications

Prime Mover:

Photovoltaic _____

Reciprocating Engine _____

Fuel Cell _____

Gas Turbine _____

Steam Turbine _____

Microturbine _____

Other (specify) _____

Energy Source:

Solar _____

Wind _____

Hydro (state type i.e. Run of River _____)

Diesel _____

Natural Gas _____

Fuel Oil _____

Other (state type) _____

Type of Generating Facility: _____ Inverter _____ Synchronous _____ Induction

Generating Facility Nameplate Rating: _____ kW or _____ kVA

Applicant Site Load: _____ kW (if none, so state)

Typical Reactive Load (if known): _____

Maximum Physical Export Capability Requested: _____ kW

List components of the Interconnection Equipment Package that are UL listed or IEEE certified:

Equipment Type:

Certifying Entity:

1. _____

Evergy

Facility Interconnection Requirements

2.

3.

Is the prime mover compatible with the Interconnection Equipment Package?

Yes No

Individual generator data (attach additional sheets if needed)

Manufacturer, Model Name & Number: _____

Version
Number: _____

Nameplate Output Power Rating in kW: _____ (Winter)
(Summer) _____

Nameplate Output Power Rating in kVA: _____ (Winter)
(Summer) _____

Rated Power Factor: (Leading) _____ (Lagging) _____

Total number of generators to be interconnected pursuant to this
application: _____

Elevation: _____

Single Phase: Three Phase: (check one)

List of adjustable set points for the protective equipment or
software:

Inverter based Generating Facilities

Inverter Manufacturer, Model Name & Number: _____

Max design fault current contribution (choose one):

Asymmetrical _____ Amps

Symmetrical _____ Amps

Harmonics Characteristics: _____

Start-up requirements: _____

Rotating Machines (of any type)

RPM Frequency: _____

(*) Neutral Grounding Resistor (If applicable): _____

Synchronous Generators

Direct Axis Synchronous Reactance, Xd: _____ P.U.

Direct Axis Transient Reactance, X'd: _____ P.U.

Direct Axis Sub transient Reactance, X''d: _____ P.U.

Negative Sequence Reactance, X2: _____ P.U.

Zero Sequence Reactance, X0: _____ P.U.

kVA Base: _____

Field Volts: _____

Field Amperes: _____

For synchronous generators, provide appropriate IEEE model block diagram of excitation system, governor system, and power system stabilizer (PSS in accordance with the Regional Reliability Council criteria). A PSS may be determined to be required by applicable studies. A copy of the manufacturer's block diagram may not be substituted.

Induction Generators

Motoring Power (kW): _____

I²t or K (Heating Time Constant): _

Rotor Resistance, Rr: _____ Rotor Reactance, Xr: _____

Stator Resistance, Rs: _____ Stator Reactance, Xs: _____

Magnetizing Reactance, Xm: _____

Short Circuit Reactance, Xd: _____

Exciting Current: _____

Temperature Rise: _____

Frame Size: _____

Design Letter: _____

Reactive Power Required in Vars (No Load): _____

Reactive Power Required in Vars (Full Load): _____

Total Rotating Inertia, H: _____ Per Unit on kVA Base

3.0 Transformer and Protective Relay Specifications

Will a transformer be used between the generator and the Facility Interconnection?

_____ Yes _____ No

Will the transformer be provided by the Owner? _____ Yes _____ No

Transformer: _____ percent on _____ kVA Base

If Three Phase:

Transformer Primary Grounded: _ Volts _ Delta _ Wye _ Wye Grounded

Transformer Secondary: _____ Volts _____ Delta _____ Wye _____ Wye Grounded

Transformer Tertiary Grounded: _____ Volts _____ Delta _____ Wye _____ Wye Grounded

Transformer Fuse Data (if applicable, for Owner’s fuse)
(Attach copy of fuse manufacturer’s Minimum Melt and Total Clearing Time-Current Curves)

Manufacturer: Type: _____ Size: _____ Speed: _____

Interconnecting Circuit Breaker (if applicable):

Manufacturer: _____ Type: _____

Load Rating (Amps): ____ Interrupting Rating (Amps): ____ Trip Speed (Cycles): _____

Interconnection Protective Relays (if applicable):

If Microprocessor-Controlled:

List of Functions and Adjustable Set points for the protective equipment or software:

Set point Function	Minimum	Maximum
_____	_____	_____
_____	_____	_____
_____	_____	_____

Discrete Components (if applicable):

(Enclose Copy of any Proposed Time-Overcurrent Coordination Curves)

Manufacturer: ____ Type: _

Style/Catalog No: _____

Proposed Setting: _____

Manufacturer: ____ Type: _

Style/Catalog No: _____

Proposed Setting: _____

Manufacturer: ____ Type: _

Style/Catalog No: _

Proposed Setting: _

Current Transformer Data (if applicable):

(Enclose Copy of Manufacturer’s Excitation and Ratio Correction Curves)

Manufacturer: _____

Type: _____ Accuracy Class: _____ Proposed Ratio Connection: _____

Potential Transformer Data (if applicable):

Manufacturer: _____

Type: _____ Accuracy Class: _____ Proposed Ratio Connection: _____

4.0 General Information

Enclose copy of site electrical one-line diagram showing the configuration of all Generating Facility Equipment, current and potential circuits, and protection and control schemes. This one-line diagram must be signed and stamped by a licensed Professional Engineer if the Generating Facility is larger than 200 kW.

Is one-line diagram enclosed? ___ Yes ___ No

Enclose copy of any site documentation that indicates the precise physical location of the proposed Generating Facility and all protective equipment (e.g. USGS topographic map or other diagram or documentation).

Is site documentation enclosed? ___ Yes ___ No

Enclose copy of any site documentation that describes and details the operation of the protection and control schemes.

Is available documentation enclosed? ___ Yes ___ No

Enclose copies of schematic drawings for all protection and control circuits, relay current circuits, relay potential circuits, and alarm/monitoring circuits (if applicable).

Are schematic drawings enclosed? ____ Yes ____ No

5.0 Applicant Signature

I hereby certify that to the best of my knowledge, all the information provided in this Facility Interconnection Standard Application is true and correct. Generating Facilities must be compliant with IEEE, NEC, ANSI, and UL standards, where applicable. By signing below, the Applicant also certifies that the installed generating equipment meets the appropriate proceeding requirement(s) and can supply documentation that confirms compliance.

Signature of Applicant: _

Date: _____

Written applications should be submitted by mail or email:

Retail Services:

Evergy
Energy Solutions
P.O. Box 418679
Kansas City, MO 64105

Wholesale Services:

Evergy
Sr. Manager, T&D Planning
P.O. Box 418679
Kansas City, MO 64105
longtermplanning@evergy.com

Attachment A - Phasor Measurement Units Specifications

A1.0 Scope

The purpose of this specification is to provide information about Companies' requirements for Phasor Measurement Units (PMU) and associated hardware.

A2.0 Electrical Hardware

The Phasor Measurement Unit (PMU) shall meet or exceed the following criteria:

1. IEEE C37.118-2005 Protocol:
 - a. Up to 60 Messages per Second.
 - b. Level 1 at maximum message rate when phasor has the same frequency as phase A voltage, frequency-based phasor compensation is enabled (PHCOMP = Y), and the narrow-bandwidth filter is selected (PMAPP = N). Out-of-band interfering frequency (Fs) test, $10 \text{ Hz} \leq F_s \leq (2 \cdot \text{NFREQ})$.
2. Current Range: 0.5 – 10 Amps secondary.
3. Frequency Range: ± 5 Hz of nominal.
4. Voltage Range: 30 V-250 V.
5. Phase Angle Range: -179.99° to 180° .

The installation will have one Phasor Data Concentrator (PDC) that shall meet or exceed the following criteria:

1. Concentrate up to 120 IEEE C37.118-2005 or C37.118-2011 PMUs at rates up to 240 messages/second via 2 Ethernet and up to 26 RJ45 serial ports.
2. Configure up to ten independent output streams to provide data to Companies or the SPP.
3. Have continuous, local data storage up to 250 GB SDD in either COMTRADE or CSV formats.

The installation may need to include an Ethernet Gateway switch if one is not already present. The Ethernet Gateway switch shall meet or exceed the following criteria:

1. Deny-by-default firewall with Internet Protocol Security (IPsec) VPNs.
2. User-based access controls and detailed activity logs.
3. HTTPS web interface for secure setup and management.

The installation may need to include a GPS satellite-synchronized clock if one is not already present. The GPS satellite-synchronized clock shall meet or exceed the following criteria:

1. Demodulated IRIG-B outputs with ± 100 nanosecond accuracy.
2. Six demodulated IRIG-B time-code outputs.

A3.0 Recommended and Proven Equipment

The following equipment has been proven and found to be acceptable by Companies:

1. PMU: SEL-351A – Part Number 0351A1R2X3E54X1 – Key Code 7438
2. PDC: SEL-3573 Station Phasor Data Concentrator – Configuration Number 3573#JB8J
3. Ethernet Gateway: SEL-3620 Ethernet Security Gateway – Configuration Number 3620#0101
4. GSP Satellite-Synchronized Clock: SEL-2407 – Part Number 24070001B

Attachment B - Generator Interconnection Data Requirements for Synchronous Machines

Data Request Background

By interconnecting to the Companies' transmission system, Evergy is designated as the interconnection facility and Customer's Transmission Planner (TP). A TP is an entity defined by the North American Electric Reliability Corporation (NERC) that has certain requirements and obligations (requirements) to meet Electric Utility Industry Standards (Standards). Among other things, these requirements involve developing a model of the interconnecting facility for use in transmission studies.

To adequately assess the transmission system for the proposed facility interconnect (plant), a Generator Interconnection (GI) study must be performed. While the Customer must make a formal data submission to the Southwest Power Pool (SPP) and participate in an SPP regional GI study, Evergy performs an independent study to capture impacts local to the Evergy system and to establish an initial data collection from the Customer.

Evergy will make an initial data request to the Customer for the purposes of studying the proposed interconnection. A subsequent data request will be made inside of 180 days prior to the initial synchronization listed in Appendix B of the SPP Generator Interconnection Agreement. Once the facility is built and in service Evergy may submit additional data requests. The Customer is required by NERC standard MOD-032 Requirement R3 to provide data within 90 days. Per NERC Standard MOD-032, Requirement R2, the Customer is required to provide power flow, short circuit, and dynamic model data.

All data provided to Evergy is owned by the Customer and, therefore, cannot be modified by Evergy (unless Evergy is also the Customer) for MOD-032 compliance. This means that the Customer is required to provide sufficient plant models. This includes generating unit models, corresponding generator step-up transformer (GSU) models, and models for any transformers and transmission lines owned by the Customer for the interconnecting facility.

The Customer shall provide as much detail as possible. Some data may not be available due to incomplete records or because a facility is not yet built.

Frequency of Data Updates

When connecting to the Bulk Electric System (BES), the Customer is required by NERC to provide data and data updates to the TP. Some NERC Standards have data reporting frequencies and those must be reviewed and provided by the Customer as required. However, in accordance with NERC Standard MOD-032, the Customer must provide steady-state, short circuit, and dynamic modeling information to the TP per the modeling schedule set forth by the Planning Coordinator (PC), SPP. SPP builds cases on annual basis and requests data updates annually.

Deliverables

This section summarizes what information is expected to be communicated from one entity to another.

Transmission Planner and Planning Coordinator

The Transmission Planner (Evergy) and Planning Coordinator (SPP) will collaborate to provide the Customer with:

- System impedance data and available fault current at the Point of Interconnect (POI)
- A list of dynamics models acceptable to the TP (Evergy), including:
 - o Parameter sheet(s)
 - o Block diagram(s)

Generator Owner (Customer)

The Customer should provide the following data to both the Planning Coordinator (SPP) and the Transmission Planner (Evergy):

- Load flow model in PSSE v33 RAW format, including all:
 - o Transmission lines owned by the Customer
 - o Primary station transformers owned by the Customer (i.e., 345/69 kV transformers)
 - o Generator step-up transformers owned by the Customer
 - o Generators
- Short circuit model for all load flow facilities (previously noted) in PSSE v33 SEQ format
- Dynamic models from the list of approved models provided by the TP in PSSE v33 DYR format for each generator:
 - o Generator model (e.g., GENTPJU1)
 - o Compensator model, if applicable (e.g., IEEEVC)
 - o Stabilizer model, if applicable (e.g., PSS2B)
 - o UEL, if applicable (e.g., UEL1)
 - o OEL, if applicable (e.g., MAXEX1)
 - o Excitation control system model, if applicable (e.g., AC7B)
 - o Turbine/Governor control system model (e.g., GCustomerV1DU)
 - o Turbine load controller, if applicable (i.e., LCFB1)
 - o Generator protection models (e.g., VTGDCAT, FRQDCAT, LOEXR1T, VPERHZU1)
- Dynamic models in PSSE v33 DYR format for each GSU:
 - o Generator saturation model, if available (e.g., SAT2T)

Steady-State, Short Circuit, and Dynamic Data Requirements

Evergy as the TP requires a great deal of data to accurately model the plant in the Siemens PTI Power System Simulator for Engineers (PSS/E) software package. Since Evergy does not own the plant, the Customer is responsible for and must provide enough data to create an accurate model in PSS/E. The complete data requirements are listed in the following sections. Not all data is required.

Example Plant Model

For most synchronous machines, Companies requires an explicit model of each unit and its corresponding GSU for interconnection-wide studies.

Figure 1: One-Line Representation of Example Interconnecting Facility Model. provides an example of a one-line diagram of the interconnecting facility. Besides bus numbers, data for all elements shown in the Interconnecting Facility should be provided. In the given example, the connecting facility is located at an existing Companies transmission facility.

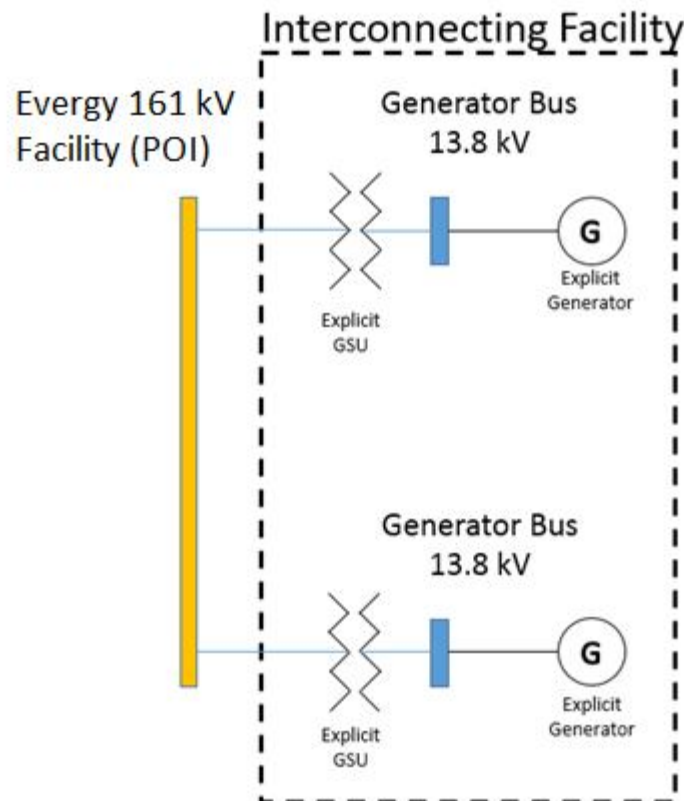


Figure 1: One-Line Representation of Example Interconnecting Facility Model

Load Flow

Load Flow refers to the plant’s electrical topology and operating limits. This includes things like transformer impedance, generator capability, and equipment ratings. These data help establish the location of the plant in relation to the Companies transmission system as well as inform Companies of the operating limits of the plant. The information is requested to help create the

Evergy

Facility Interconnection Requirements

load flow model of the plant. If some information is not available, the Customer should note what information is not available and discuss with the TP to determine if proxy data can be used.

Table 1: Requested Substation Power Flow Data

Data Requested	Desired Units	Data Value
Station Ground-Grid DC Resistance (e.g., value from Fall-of-Potential Test)	Ohms	

Table 2: Requested Generator Power Flow Data

Data Requested	Desired Units	Data Value
EIA Plant Code		
Original design parameter sheet		
D-Curves		
Fuel Type 1 (e.g., Coal, Hydro, Gas, etc.)		
Fuel Type 2 (e.g., Coal, Hydro, Gas, etc.)		
Is part of combined-cycle plant?	Yes or No	
Is steam unit of combined-cycle plant?	Yes or No	
Inertia Constant	ratio	
Overspeed Droop Setting	Hz	
Underspeed Droop Setting	Hz	
Droop Deadband Setting		
Generator Bus Number (PSSE/PSLF/PowerWorld/TSAT)	long integer	
Real output (over-excited, Min; Pmax)	MW	
Real output (under-excited, Max; Pmin)	MW	
Reactive output (over-excited, Max)	MVAR	
Reactive output (over-excited, Min)	MVAR	
Reactive output (under-excited, Max)	MVAR	
Reactive output (under-excited, Min)	MVAR	
Rated Power Factor		
Rated RPM	RPM	
Rated Frequency	Hz	
Power Base	MVA	
Armature Resistance	Ohms	
D-Axis Unsaturated Sub-Transient Reactance	PU on MVA Base	
Owner #1		
Owner #2		
Owner #3		
Owner #4		
Owner #1 Fraction	%	
Owner #2 Fraction	%	
Owner #3 Fraction	%	
Owner #4 Fraction	%	

Data Requested	Desired Units	Data Value
Real Auxiliary Load (over-excited, Max)	MW	
Real Auxiliary Load (over-excited, Min)	MW	
Real Auxiliary Load (under-excited, Max)	MW	
Real Auxiliary Load (under-excited, Min)	MW	
Reactive Auxiliary Load (over-excited, Max)	MVAR	
Reactive Auxiliary Load (over-excited, Min)	MVAR	
Reactive Auxiliary Load (under-excited, Max)	MVAR	
Reactive Auxiliary Load (under-excited, Min)	MVAR	
Typical voltage set point (voltage schedule)	PU on generator kV base e.g., "Low-Side of GSU", "High-Side of GSU", etc.	
Regulated Bus		

Table 3: Requested Two-Winding Transformer Power Flow Data

Data Requested	Desired Units	Data Value
Serial Number		
Test Report		
Date No-Load Tap Changer Setting was Verified	MM/DD/YYYY	
Core Construction	"Single-Phase", "Core-Type, 3-Legs", "Core-Type, 5-Legs", "Core-Type, 7 Legs", or "Shell-Type"	
H-Winding has GIC Blocking Device?	Yes/No	
X-Winding has GIC Blocking Device?	Yes/No	
H-Winding DC Resistance	Ohms	
X-Winding DC Resistance	Ohms	
DC Winding Resistance Temperature	degrees	
Transformer Number	two-character identifier	
H-Winding Nominal Voltage	kV	
X-Winding Nominal Voltage	kV	
No-Load Tap Changer exists?	Yes/No	
No-Load Tap Changer winding	H or X	
Number of No-Load Tap Changer Steps	Integer or Letter (e.g., 3 or C)	
No-Load Tap Changer Step %	%	
Present No-Load Tap Changer Setting	Integer or Letter (e.g., 2 or B)	
Load Tap Changer exists?	Yes/No	
Load Tap Changer winding	H or X	
Number of Load Tap Changer Steps	Integer or Letter (e.g., 3 or C)	
Load Tap Changer Step %	%	
No-Load Losses	W	
Exciting Current	% at 100% rated voltage	
Vector Group	Characters	
Phase shift angle	degrees	
Load Loss (corrected to 85C)	W	
Impedance (corrected to 85C)	%	

Data Requested	Desired Units	Data Value
Load Loss and Impedance S Base	MVA	
H-Winding Oil Normal, Air Normal (ONAN) Rating	MVA	
H-Winding Oil Normal, Air Forced (ONAF) Rating	MVA	
H-Winding Oil Forced, Air Normal (OFAN) Rating	MVA	
H-Winding Oil Forced, Air Forced (OFAF) Rating	MVA	
H-Winding Switch Gear Rating	MVA	
H-Winding Switch Gear Impedance	Ohms	
H-Winding Jumper Conductor	Conductor Call sign (e.g., Tern, Drake, etc.)	
H-Winding Number of Jumper Conductors	Integer	
H-Winding Current-Transformer (CT) Tap Settings	Ratio (e.g., 1000:5)	
H-Winding CT Rating Factor	Float (e.g., 1.0, 1.5, 2.0, etc.)	
H-Winding Present Minimum CT Tap Setting	Ratio (e.g., 1000:5)	
H-Winding Series Reactor Impedance	Ohms	
H-Winding Series Reactor Type	Type (e.g., air-core, epoxy, etc.)	
H-Winding Series Reactor Rating	MVA	
X-Winding Oil Normal, Air Normal (ONAN) Rating	MVA	
X-Winding Oil Normal, Air Forced (ONAF) Rating	MVA	
X-Winding Oil Forced, Air Normal (OFAN) Rating	MVA	
X-Winding Oil Forced, Air Forced (OFAF) Rating	MVA	
X-Winding Switch Gear Rating	MVA	
X-Winding Switch Gear Impedance	Ohms	
X-Winding Jumper Conductor	Conductor Call sign (e.g., Tern, Drake, etc.)	
X-Winding Number of Jumper Conductors	Integer	
X-Winding Current-Transformer (CT) Tap Settings	Ratio (e.g., 1000:5)	
X-Winding CT Rating Factor	Float (e.g., 1.0, 1.5, 2.0, etc.)	
X-Winding Present Minimum CT Tap Setting	Ratio (e.g., 1000:5)	
X-Winding Series Reactor Impedance	Ohms	
X-Winding Series Reactor Type	Type (e.g., air-core, epoxy, etc.)	
X-Winding Series Reactor Rating	MVA	

Table 4: Requested Three-Winding Transformer Power Flow Data

Data Requested	Desired Units	Data Value
Serial Number	--	
Test Report		
Date No-Load Tap Changer Setting was Verified	MM/DD/YYYY	
Core Construction	--	
H-Winding has GIC Blocking Device?	Yes/No	
X-Winding has GIC Blocking Device?	Yes/No	
Y-Winding has GIC Blocking Device?	Yes/No	
H-Winding DC Resistance	Ohms	
X-Winding DC Resistance	Ohms	
Y-Winding DC Resistance	Ohms	
DC Winding Resistance Temperature	degrees	
Transformer Number	two-character identifier	
H-Winding Nominal Voltage	kV	
X-Winding Nominal Voltage	kV	
Y-Winding Nominal Voltage	kV	
No-Load Tap Changer exists?	Yes/No	
No-Load Tap Changer winding	H, X, or Y	
Number of No-Load Tap Changer Steps	Integer or Letter (e.g., 3 or C)	
No-Load Tap Changer Step %	%	
Present No-Load Tap Changer Setting	Integer or Letter (e.g., 2 or B)	
Load Tap Changer exists?	Yes/No	
Load Tap Changer winding	H, X, or Y	
Number of Load Tap Changer Steps	Integer or Letter (e.g., 3 or C)	
Load Tap Changer Step %	%	
No-Load Losses	W	
Exciting Current	% at 100% rated voltage	
Vector Group	Characters	
Phase shift angle	degrees	
Load Loss (corrected to 85C)	W	
Impedance (corrected to 85C)	%	
Load Loss and Impedance S Base	MVA	
H-Winding Oil Normal, Air Normal (ONAN) Rating	MVA	
H-Winding Oil Normal, Air Forced (ONAF) Rating	MVA	
H-Winding Oil Forced, Air Normal (OFAN) Rating	MVA	
H-Winding Oil Forced, Air Forced (OFAF) Rating	MVA	
H-Winding Switch Gear Rating	MVA	
H-Winding Switch Gear Impedance	Ohms	
H-Winding Jumper Conductor	Conductor Callsign (e.g., Tern, Drake, etc.)	
H-Winding Number of Jumper Conductors	Integer	
H-Winding Current-Transformer (CT) Tap Settings	Ratio (e.g., 1000:5)	
H-Winding CT Rating Factor	Float (e.g., 1.0, 1.5, 2.0, etc.)	
H-Winding Present Minimum CT Tap Setting	Ratio (e.g., 1000:5)	

Data Requested	Desired Units	Data Value
H-Winding Series Reactor Impedance	Ohms	
H-Winding Series Reactor Type	Type (e.g., air-core, epoxy, etc.)	
H-Winding Series Reactor Rating	MVA	
X-Winding Oil Normal, Air Normal (ONAN) Rating	MVA	
X-Winding Oil Normal, Air Forced (ONAF) Rating	MVA	
X-Winding Oil Forced, Air Normal (OFAN) Rating	MVA	
X-Winding Oil Forced, Air Forced (OFAF) Rating	MVA	
X-Winding Switch Gear Rating	MVA	
X-Winding Switch Gear Impedance	Ohms	
X-Winding Jumper Conductor	Conductor Callsign (e.g., Tern, Drake, etc.)	
X-Winding Number of Jumper Conductors	Integer	
X-Winding Current-Transformer (CT) Tap Settings	Ratio (e.g., 1000:5)	
X-Winding CT Rating Factor	Float (e.g., 1.0, 1.5, 2.0, etc.)	
X-Winding Present Minimum CT Tap Setting	Ratio (e.g., 1000:5)	
X-Winding Series Reactor Impedance	Ohms	
X-Winding Series Reactor Type	Type (e.g., air-core, epoxy, etc.)	
X-Winding Series Reactor Rating	MVA	
Y-Winding Oil Normal, Air Normal (ONAN) Rating	MVA	
Y-Winding Oil Normal, Air Forced (ONAF) Rating	MVA	
Y-Winding Oil Forced, Air Normal (OFAN) Rating	MVA	
Y-Winding Oil Forced, Air Forced (OFAF) Rating	MVA	
Y-Winding Switch Gear Rating	MVA	
Y-Winding Switch Gear Impedance	Ohms	
Y-Winding Jumper Conductor	Conductor Callsign (e.g., Tern, Drake, etc.)	
Y-Winding Number of Jumper Conductors	Integer	
Y-Winding Current-Transformer (CT) Tap Settings	Ratio (e.g., 1000:5)	
Y-Winding CT Rating Factor	Float (e.g., 1.0, 1.5, 2.0, etc.)	
Y-Winding Present Minimum CT Tap Setting	Ratio (e.g., 1000:5)	
Y-Winding Series Reactor Impedance	Ohms	
Y-Winding Series Reactor Type	Type (e.g., air-core, epoxy, etc.)	
Y-Winding Series Reactor Rating	MVA	

Table 5: Requested Transmission Line Power Flow Data

Data Requested	Desired Units	Data Value
Line Length	Miles	
Conductor Type	Call Sign, Size in kcmil, strands, and class (e.g., "Rail 954 45/7 ACSR")	
Static Wire #1 type	Wire type and stranding (e.g., "3/8 EHS")	
Static Wire #2 type	Wire type and stranding (e.g., "24 OPGW, 5")	

Data Requested	Desired Units	Data Value
Line construction	e.g., "H-Frame, Single Circuit", "Single-Pole, Double Circuit", etc.	
DC Line Resistance	Ohms / Phase @ 50°C	
AC Line Resistance	PU on 100 MVA Base	
AC Line Reactance	PU on 100 MVA Base	
Line Charging	PU on 100 MVA Base	
Conductor Rating (50°C)	MVA	
Conductor Rating (40°C)	MVA	
Conductor Rating (30°C)	MVA	
Conductor Rating (20°C)	MVA	
Conductor Rating (10°C)	MVA	
Conductor Rating (0°C)	MVA	
Line Switch Rating (normal)	MVA	
Line Switch Rating (emergency)	MVA	
Line Breaker Rating (normal)	MVA	
Line Breaker Rating (emergency)	MVA	
Line CT Current Tap Setting	ratio (e.g., "2000:5")	
Line CT Rating Factor		
Line CT Maximum Tap Setting	ratio (e.g., "2000:5")	
Wave-Trap Rating (normal)	MVA	
Wave Trap Rating (emergency)	MVA	
Series Shunt Rating (normal)	MVA	
Series Shunt Rating (emergency)	MVA	
Number of Jumpers per Phase		
Jumper Type	Call Sign, Size in kcmil, strands, and class (e.g., "Rail 954 45/7 ACSR")	
Jumper Rating (normal)	MVA	
Jumper Rating (emergency)	MVA	
Has Metal-Oxide Varistor (MOV) Protection?	"Yes" or "No"	
	0 = No MOV 1 = MOV Protection Enabled 2 = MOV Protection Disabled 3 = MOV Spark-Gap Protection	
MOV Protection Type		
MOV Voltage Rating (continuous)	kV	
MOV Current Rating (continuous)	kA	
Owner #1		
Owner #2		
Owner #3		
Owner #4		
Owner #1 Fraction	%	
Owner #2 Fraction	%	
Owner #3 Fraction	%	
Owner #4 Fraction	%	

Table 6: Requested Shunt Capacitor/Reactor Data

Data Requested	Desired Units	Data Value
Is Static Var Compensator (SVC)?	Yes or No	
Total amount of capacitance	MVAR	

Data Requested	Desired Units	Data Value
Number of capacitive blocks		
Number of steps per capacitive block		
Amount of capacitance per step	MVAR	
Total amount of reactance	MVAR	
Number of reactive blocks		
Number of steps per reactive block		
Amount of reactance per step	MVAR	
DC Resistance	Ohms/Phase	
Grounding Resistance	Ohms	
Grounding Connection	Grounded Wye, Wye, Delta	

Short Circuit

Short circuit data allows Companies to assess the ability of the transmission system to interrupt fault current provided by the plant. It will aid in determination of the ability of existing breakers and circuit switchers to handle fault current provided by the new plant. In addition, this data helps size breakers, circuit switchers, and or switches at the new point of interconnect (POI). Data requested is listed in is requested to help create a short circuit model of the plant.

Table 77: Requested Generator Short Circuit Data

Data Requested	Desired Units	Data Value
Positive Sequence Armature Resistance	PU on MVA Base	
D-Axis Saturated Sub-Transient Reactance	PU on MVA Base	
D-Axis Saturated Transient Reactance	PU on MVA Base	
D-Axis Saturated Synchronous Reactance	PU on MVA Base	
Negative Sequence Armature Resistance	PU on MVA Base	
Negative Sequence Reactance	PU on MVA Base	
Zero Sequence Armature Resistance	PU on MVA Base	
Zero Sequence Reactance	PU on MVA Base	
Grounding Transformer high-side kV	kV	
Grounding Transformer low-side kV	kV	
Grounding resistance	ohms	
Grounding reactance	ohms	

Table 8: Requested Two-Winding Transformer Short Circuit Data

Data Requested	Desired Units	Data Value
Is Autotransformer?	Yes/No	
Zero-Sequence Resistance	% on test MVA base	
Zero-Sequence Reactance	% on test MVA base	
Test MVA	MVA	
H-Winding Grounding Resistance	Ohms	
H-Winding Grounding Reactance	Ohms	
X-Winding Grounding Resistance	Ohms	
X-Winding Grounding Reactance	Ohms	
Neutral Resistance	Ohms	
Neutral Reactance	Ohms	

Table 9: Requested Three-Winding Transformer Short Circuit Data

Data Requested	Desired Units	Data Value
Is Autotransformer?	Yes/No	
Which windings are auto?	H-X, X-Y, or H-Y	
Zero-Sequence Resistance 1	% on test MVA base; Z1No, H, or H-X	
Zero-Sequence Reactance 1	% on test MVA base; Z1No, H, or H-X	
Zero-Sequence Resistance 2	% on test MVA base; Z2No, X, or X-Y	
Zero-Sequence Reactance 2	% on test MVA base; Z2No, X, or X-Y	
Zero-Sequence Resistance 3	% on test MVA base; Z1Ns, Y, or H-Y	
Zero-Sequence Reactance 3	% on test MVA base; Z1Ns, Y, or H-Y	
Test MVA	MVA	
H-Winding Grounding Resistance	Ohms	
H-Winding Grounding Reactance	Ohms	
X-Winding Grounding Resistance	Ohms	
X-Winding Grounding Reactance	Ohms	
Y-Winding Grounding Resistance	Ohms	
Y-Winding Grounding Reactance	Ohms	
Neutral Resistance	Ohms	
Neutral Reactance	Ohms	

Table 108: Requested Transmission Line Short Circuit Data

Data Requested	Desired Units	Data Value
AC Zero-Sequence Line Resistance	PU on 100 MVA Base	
AC Zero-Sequence Line Reactance	PU on 100 MVA Base	
Zero-Sequence Line Charging	PU on 100 MVA Base	
MOV Rated Current	kA	

Dynamics Models

Dynamics models are relatively precise device models that help Companies understand how a plant operates in real time. These models help establish the stability of the Companies system as well as determine voltage recovery issues that may arise. Depending on the type of plant, Companies requires several individual dynamic models be created for each unit. These models should be appropriate for the specific unit(s) and be developed by the Customer per Companies' list of acceptable dynamics models. Companies' list of acceptable dynamics models contains parameter worksheets, software syntax, and block diagrams and a PDF may be requested from Evergy Transmission Planning (LongTermPlanning@evergy.com).

Machine Models

Depending on the type of unit, what data is available, and what models make sense to the Customer, the TP needs the following:

- Rotor model
- Exciter System model (if applicable)
- Power System Stabilizer model (if applicable)
- Turbine/Governor System model (if applicable)
- Turbine Load Controller model (if applicable)
- Voltage Compensator model (if applicable)
- Under-Excitation Limiter system model (if applicable)
- Over-Excitation Limiter system model (if applicable)
- Over-Frequency trip models
- Under-Frequency trip models
- Over-Voltage trip models
- Under-Voltage trip models
- Loss of Excitation Distance Relay model (if applicable)
- Volts per Hertz Relay model (if applicable)

Transformers

It is possible that both Generator Step-Up Units (GSUs) and station transformers have a magnetic saturation curve supplied with the test report. As such, it is appropriate to create a transformer saturation model for use with dynamic studies.

Attachment E - Generator Interconnection Data Requirements for Asynchronous Machines

Data Request Background

By interconnecting to the Companies' transmission system, Evergy is designated as the interconnection facility and Customer's Transmission Planner (TP). A TP is an entity defined by the North American Electric Reliability Corporation (NERC) that has certain requirements and obligations (requirements) to meet Electric Utility Industry Standards (Standards). Among other things, these requirements involve developing a model of the interconnecting facility for use in transmission studies.

To adequately assess the transmission system for the proposed facility interconnect (plant), a Generator Interconnection (GI) study must be performed. While the Customer must make a formal data submission to the Southwest Power Pool (SPP) and participate in an SPP regional GI study, Evergy performs an independent study to capture impacts local to the Evergy system and to establish an initial data collection from the Customer.

Evergy will make an initial data request to the Customer for the purposes of studying the proposed interconnection. A subsequent data request will be made once the facility is built and in service. Once KPC&L has submitted an official data request, the Customer is required by NERC standard MOD-032 Requirement R3 to provide data within 90 days unless a longer time period is agreed upon, back to Evergy. Per NERC Standard MOD-032, Requirement R2, the Customer is required to provide power flow, short circuit, and dynamic model data.

All data provided to Evergy is owned by the Customer and, therefore, cannot be modified by Evergy (unless Evergy is also the Customer) for MOD-032 compliance. This means that the Customer is required to provide sufficient equivalent models for plants where four or more machines feed into one or more collector circuit(s). This includes equivalent generating unit models, corresponding equivalent generator step-up transformer (GSU) models, and models for any transformers and transmission lines owned by the Customer for the interconnecting facility. The Customer shall provide as much detail as possible. Some data may not be available due to incomplete records or because a facility is not yet built. In this case the TP requires general information so a generic model may be produced. Once a facility is in-service a supplementary data request will be made and the Customer must provide complete models within 90 days unless a longer time period is agreed upon, per NERC standard MOD-032.

Frequency of Data Updates

When connecting to the Bulk Electric System (BES), the Customer is required by NERC to provide data and data updates to the TP. Some NERC Standards have data reporting frequencies and those must be reviewed and provided by the Customer as required. However, in accordance with NERC Standard MOD-032, the Customer must provide steady-state, short circuit, and dynamic modeling information to the TP per the modeling schedule set forth by the Planning Coordinator (PC, SPP). SPP builds cases on annual basis and requests data updates annually.

Transmission Planner (TP) and Planning Coordinator (PC)

The TP and PC (SPP) will collaborate to provide the Customer with:

- System impedance data and available fault current at the Point of Interconnect (POI)
- A list of dynamics models acceptable to the TP, including:
 - o Parameter sheet(s)
 - o Block diagram(s)

Generator Owner (Customer) Deliverables

The Customer should provide the following data to both the PC and the TP for all applicable facilities owned by the Customer:

- Load flow model in PSSE v33 RAW format, including all:
 - o Transmission lines owned by the Customer
 - o Primary station transformers owned by the Customer (e.g., 345/34.5 kV transformers)
 - o Equivalent collector circuit(s) owned by the Customer
 - o Equivalent GSU(s) owned by the Customer
 - o Equivalent generator(s)
- Short circuit model for all load flow facilities previously noted in PSSE v33 SEQ format
- Approved dynamic models in PSSE v33 DYR format for each equivalent generator:
 - o Generic models (i.e., PSSE library models) are preferred
 - o Equivalent generator model (e.g., REGCAU1)
 - o Equivalent electrical control model (e.g., REECAU1)
 - o Wind mechanical control model, if applicable (e.g., WTDTAU1)
 - o PV panel model, if applicable (e.g., PANELU1)
 - o Wind pitch control model, if applicable (e.g., WTPTAU1)
 - o PV irradiance profile model, if applicable (e.g., IRRADU1)
 - o Wind aerodynamics control model, if applicable (e.g., WTARAU1)
 - o Generator protection models (e.g., VTGDCAT, FRQDCAT, LOEXR1T)
- Approved dynamic model in PSSE v33 DYR format for each plant:
 - o Plant controller model (e.g., REPCAU1)
- While it is not preferred, if black-box, vendor-supplied dynamics models are to be used, the following shall be included:
 - o Data sheets for all models to be used at the facility:
 - PDF format
 - Including a description of each ICON/CON value
 - o LIB files for all models to be used at the facility (needed for SPP compilation)
 - o DLL files for all models to be used at the facility (needed for MOD studies)

Steady-State, Short Circuit, and Dynamic Data Requirements

A great deal of data is required to accurately represent a plant in the Siemens PTI Power System Simulator for Engineers (PSSE) software package. The Customer is responsible for and must provide enough data to create an accurate model in PSSE. The complete data requirements are

listed in the following sections. Depending on plant configuration and construction, not all data may be required. The plant model should adhere to the NERC BES Definition.

Example Plant Model

A complete model of the a-synchronous plant must be developed to allow adequate assessment of the facility in interconnection-wide studies. The equivalent plant model must have an adequate electrical representation of the different classes of equipment implemented at the plant. For example, assume a wind farm with 150 turbines uses two different GE models:

- Model A has a 1.5 MW capability (100 turbines)
- Model B has a 2.0 MW capability (50 turbines)

The equivalent model provided to Evergy should have only two generators, a single an equivalent GSU, and one equivalent collector circuit. One generator represents the 150 MW capability of the 100 Model A turbines. The second generator represents the 100 MW capability of the 50 Model B turbines. The Model A generating unit requires an equivalent GSU representative of the 100 GSUs for all 100 turbines. The Model B generating unit also requires an equivalent GSU representative of the 50 GSUs for all 50 turbines. The underground lines should be appropriately combined to produce a single transmission line equivalent. All station power transformers owned by the Customer (e.g., 345/34.5 kV transformers) should be modeled explicitly. All overhead transmission lines 60 kV or above should be modeled explicitly. Based on this example, Figure 2: One-Line Diagram of Example Interconnecting Facility Model shows a one-line diagram of the equivalent facility. Besides bus numbers, data for all elements shown in the Interconnecting Facility should be provided.

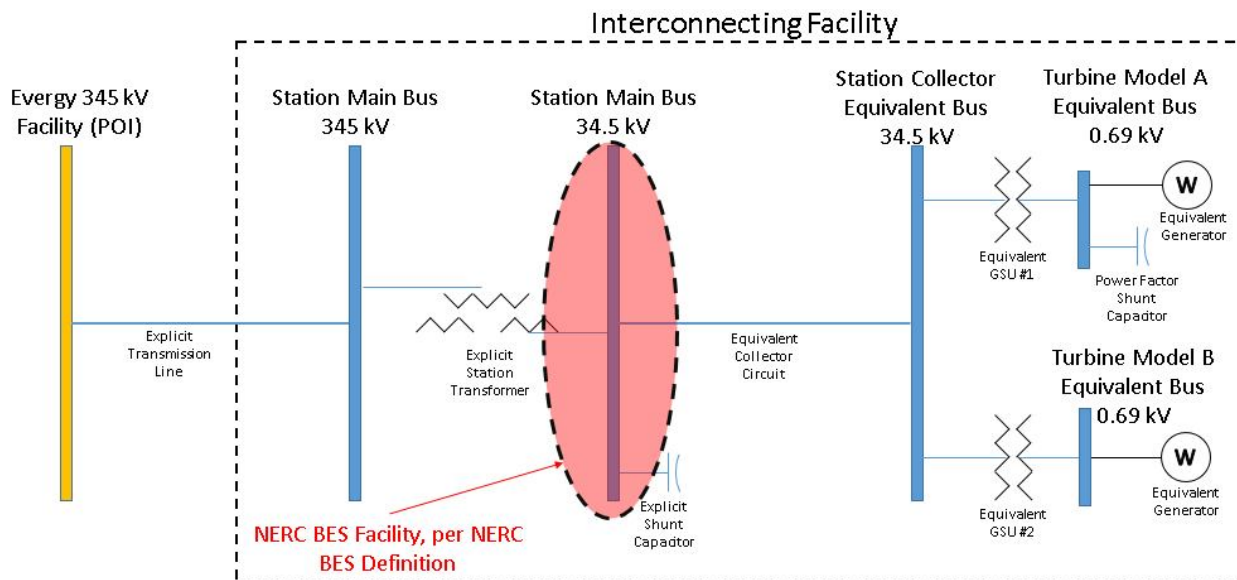


Figure 2: One-Line Diagram of Example Interconnecting Facility Model

If a normally-open bus tie exists at the interconnection, independent equivalents must be created representing all applicable generators, GSUs, and collector cables.

This situation is depicted in Figure 3: As-Built One-Line Diagram Showing Two

Independent Collector Circuits where breaker 52-BT is operated normally open. Figure 4: One-Line Diagram Depicting a Normally-Open 34.5 kV Bus Tie at the Customer Substation provides an example of how this situation must be represented for transmission models.

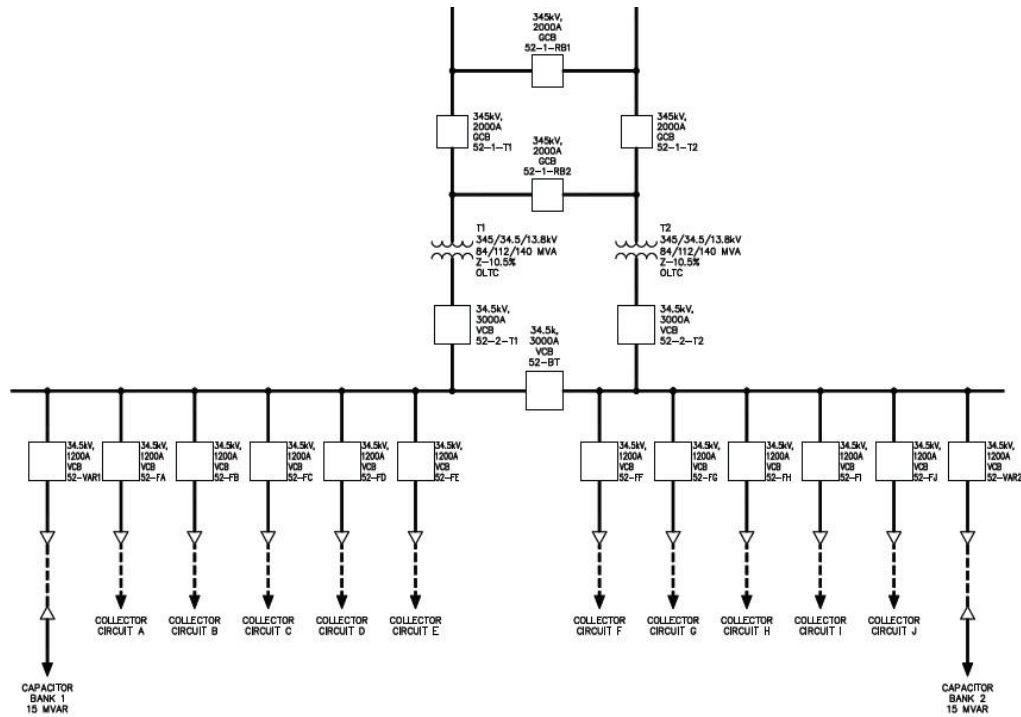


Figure 3: As-Built One-Line Diagram Showing Two Independent Collector Circuits

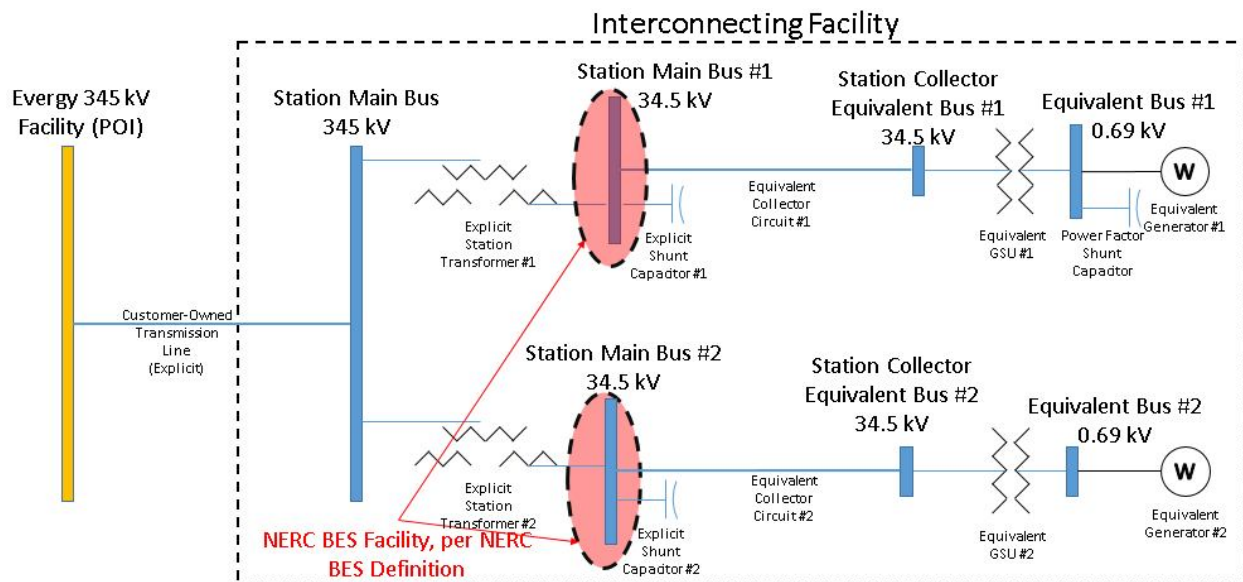


Figure 4: One-Line Diagram Depicting a Normally-Open 34.5 kV Bus Tie at the Customer Substation

Facility Rating Data (NERC Standard FAC-008)

The Customer is also required to establish thermal ratings for all the plant’s facilities (i.e., series elements modeled in PSSÉ). Evergy cannot rate these facilities and is not responsible for

Everygy Facility Interconnection Requirements establishing ratings at the Customer’s facility. Typically, thermal ratings include, but are not limited to, the following: normal and emergency conductor ratings, normal and emergency jumper ratings, substation layout, bus normal and emergency ratings, breaker ratings, switch ratings, CT settings, CT thermal rating factor (TRF), and line relay limits. The most limiting normal and emergency ratings are used to establish the final facility ratings. The Customer has the option of either filling out the appropriate data in the tables below or providing their own FAC-008 documentation that contains all required rating data. The facility must be able to operate at full output using the Normal Rating, this includes the equivalent GSU(s) and equivalent feeder circuit(s).

Transmission Interconnection Substation Data

Everygy requires a proposed or as-built facility one-line diagram for both the Customer’s Interconnection Facility (illustrates transmission voltage to collection network voltage) and the collection network (illustrates the wind farm from the Customer’s Interconnection Facility to the individual wind generators with typical or intended collection feeder design).

In addition to these diagrams the TP requires data for Geo-Magnetic Disturbance (GMD) vulnerability assessments, per NERC Standard TPL-007. The information required for these studies is outlined in Table 9.

Table 9: Required Transmission Interconnection Substation Data

#	Parameter	Data	Units
1	Station ground-grid DC resistance (e.g., value from Fall-of-Potential Test)		Ohms
2	Substation Latitude		degrees
3	Substation Longitude		degrees
4	Interconnection Facility Substation Diagram	(please attach)	
5	Plant Collection Network Diagram	(please attach)	

Power Plant Data

The steady state and dynamic response of the power plant depends upon the aggregate plant real and reactive capabilities as well as the plant control characteristics.

Table 10: Required Generator Power Flow Data

#	Parameter	Data	Units
1	EIA plant code		
2	Energy source (e.g., wind, solar, etc.)		
3	Total plant maximum real power capability (P _{MAX})		MW
4	Total plant maximum reactive power capability (Q _{MAX})		MVAR
5	Where will the plant regulate voltage (e.g., POI bus or low-side of Interconnection transformer)		
6	To what voltage will the regulated bus be controlled?		PU
7	Over-speed droop setting		Hz
8	Under-speed droop setting		Hz
9	Droop deadband setting		± Hz
10	Energy storage solution (e.g., battery, fly-wheel, etc.)		
11	Energy storage real power capability		MW
12	Energy storage rated power factor		
13	Energy storage manufacturer		
14	Energy storage data sheet	(please attach)	

Table 11: Required Plant Dynamic Data

#	Data Requested	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 12: Required Energy Storage Solution Data

#	Data Requested	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Equivalent Generator Data

Individual turbine characteristics can impact the steady state and stability response of a unit. The data in Table 13 through Table 24 should be provided for each type of generator included at the Customer’s Interconnection Facility.

Table 13: Required Equivalent Generator Data

#	Parameter	Data	Units
1	Wind turbine or solar PV manufacturer		
2	Wind turbine or solar PV model		
3	Wind turbine type: 1. Not applicable 1. Directly connected to AC system (uncommon) 2. Induction generator with controlled external rotor resistor 3. Doubly-fed induction generator 4. Wind generator with power converter 5. Speed/Torque converter powering synchronous generator		
4	Individual turbine maximum real power capability		MW
5	Individual turbine minimum power capability (cut-in rating)		MW
6	Individual turbine rated power factor (leading)		
7	Individual turbine rated power factor (lagging)		
8	Individual turbine MVA rating		MVA
9	Rated turbine output frequency		Hz
10	Total number of wind turbines represented by equivalent		
11	Equivalent machine maximum real power capability (P _{MAX})		MW
12	Equivalent machine minimum real power capability (P _{MIN})		MW
13	Equivalent machine maximum reactive power capability (Q _{MAX})		MVAR
14	Equivalent machine minimum reactive power capability (Q _{MIN})		MVAR
15	Equivalent machine Power Factor		
16	Equivalent machine MVA base rating		MVA
17	Maximum machine voltage		per-unit
18	Maximum machine current (I _{max})		Per-unit on full-load current base
19	Equivalent machine impedance ($X = 1.0 - (I_{max} - 1.0)$)		per-unit
20	Generator manufacturer's technical datasheet summary	(please attach)	

Table 14: Required Equivalent Generator Dynamic Generator/Converter Data

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 15: Required Equivalent Dynamic Electrical Control Data

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 16: Required Equivalent Dynamic Mechanical Control Model (Wind Plants Only)

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 17: Required Equivalent Dynamic Wind Pitch Control Model (Type 3 Wind Plants Only)

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 18: Required Equivalent Dynamic Wind Aerodynamic Model (Type 1, 2, and 3 Wind Plants Only)

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 19: Required Equivalent Dynamic Solar Panel Model (Solar Plants Only)

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 20: Required Equivalent Dynamic Irradiance Profile Model (Solar Plants Only)

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 21: Required Equivalent Dynamic Loss-of-Excitation Distance Relay Model (If Applicable)

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 22: Required Equivalent Generator Dynamic Low Voltage Ride Through Model (If Applicable)

#	Parameter	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 23: Required Over-/Under-Voltage Protection Tripping Limits

#	Parameter	Data	Units
1	Instantaneous high-voltage limit		%
2	Relay pickup time for instantaneous high-voltage trip		seconds
3	Timed trip high-voltage threshold		%
4	Timed high-voltage trip relay time delay setting		seconds
5	Instantaneous low-voltage limit		%
6	Relay pickup time for instantaneous low-voltage trip		seconds
7	Timed low-voltage threshold		%
8	Timed low-voltage trip relay time delay setting		seconds

Table 24: Required Over-/Under-Frequency Protection Tripping Limits

#	Parameter	Data	Units
1	Instantaneous high-frequency limit		Hz
2	Relay pickup time for instantaneous high-frequency trip		seconds
3	Timed trip high-frequency threshold		Hz
4	Timed high-frequency trip relay time delay setting		seconds
5	Instantaneous low-frequency limit		Hz
6	Relay pickup time for instantaneous low-frequency trip		seconds
7	Timed low-frequency threshold		Hz
8	Timed low-frequency trip relay time delay setting		seconds

Equivalent GSU Data

If multiple equivalent GSUs are present, this data request should be populated for each applicable GSU.

Table 25: Required Equivalent GSU Data

#	Parameter	Data	Units
1	Is auto-transformer (yes or no)?		
2	Transformer core construction: 1. Single-phase bank 2. Three-phase, shell-type 3. Three-phase, core-type (3 legs) 4. Three-phase, core-type (5 legs) 5. Three-phase, core-type (7 legs)		
3	Nominal H-winding phase-to-phase voltage		kV
4	H-winding connection configuration		Grounded-Y, Y, or Δ
5	H-winding fixed tap setting, if present		kV
6	Nominal secondary X-winding phase-to-phase voltage		kV
7	X-winding connection configuration		Grounded-Y, Y, or Δ
8	X-winding Load Tap Changer (LTC) present (yes or no)?		
9	If applicable, number of LTC steps		
10	If applicable, LTC control method (e.g., voltage, real power flow, etc.)		
11	LTC regulation range (plus/minus of nominal)		±%
12	H-winding impedance base		MVA
13	Average no-load losses at 100% voltage and corrected to 85°C		W
14	Average no-load exciting current at 100% voltage and corrected to 85°C		%
15	Average no-load conductance (G)		per-unit on H-winding MVA base
16	Average no-load susceptance (B)		per-unit on H-winding MVA base
17	Average H-X load losses at nominal tap, corrected to 85°C		W
18	Average H-X load loss impedance at nominal tap, corrected to 85°C		%
19	Equivalent H-X winding positive sequence resistance		per-unit on H-winding MVA base
20	Equivalent H-X winding positive sequence reactance		per-unit on H-winding MVA base
21	Zero-sequence impedance base		MVA
22	Average zero-sequence resistance		%

#	Parameter	Data	Units
23	Average zero-sequence reactance		%
24	Equivalent zero-sequence resistance R01 (if applicable)		per-unit on H-winding MVA base
25	Equivalent zero-sequence reactance X01 (if applicable)		per-unit on H-winding MVA base
26	Equivalent zero-sequence grounding resistance Rg1 (if applicable)		per-unit on H-winding MVA base
27	Equivalent zero-sequence grounding reactance Xg1 (if applicable)		per-unit on H-winding MVA base
28	Equivalent zero-sequence resistance R02 (if applicable)		per-unit on H-winding MVA base
29	Equivalent zero-sequence reactance X02 (if applicable)		per-unit on H-winding MVA base
30	Equivalent zero-sequence grounding resistance Rg2 (if applicable)		per-unit on H-winding MVA base
31	Equivalent zero-sequence grounding reactance Xg2 (if applicable)		per-unit on H-winding MVA base
32	Equivalent neutral resistance (if applicable)		per-unit on H-winding MVA base
33	Equivalent neutral reactance (if applicable)		per-unit on H-winding MVA base
34	Transformer winding temperature rise (55°C, 65°C, or 55/65°C)		
35	Equivalent transformer continuous rating		MVA
36	Equivalent transformer eight-hour emergency rating		MVA
37	GSU nameplate(s)	(please attach)	
38	GSU test report(s)	(please attach)	

Equivalent Collector Circuit Data

If multiple equivalent collector circuits are present, this data request should be populated for each applicable collector circuit.

Table 26: Required Equivalent Collector Circuit Data

#	Parameter	Data	Units
1	Nominal line phase-to-phase voltage		kV
2	Number of collection feeders per equivalent circuit		
3	Total length of feeder network		miles
4	Positive sequence resistance (R1)		per-unit on 100 MVA
5	Positive sequence reactance (X1)		per-unit on 100 MVA
6	Line charging (B)		per-unit on 100 MVA
7	Zero sequence resistance (R0)		per-unit on 100 MVA
8	Zero sequence reactance (X0)		per-unit on 100 MVA
9	Zero sequence line charging (B0)		per-unit on 100 MVA
10	Continuous rating of aggregate feeder network		MVA
11	Eight-hour emergency rating of aggregate feeder network		MVA
12	Line is protected by Metal-Oxide Varistor (MOV); yes or no		
13	MOV protection mode (choose one of the following): 1. MOV protection enabled 2. MOV protection disabled 3. Spark-gap protection		
14	MOV rated current		kA
15	MOV continuous rating		MVA
16	MOV eight-hour emergency rating		MVA

Customer’s Interconnection Transmission Line Data

If the Customer owns multiple applicable interconnection transmission lines, this data request should be populated for all applicable lines.

Table 27: Required Customer Interconnection Line Data

#	Parameter	Data	Units
1	Nominal line phase-to-phase voltage		kV
2	Length of interconnection transmission line		miles
3	Phase conductor call-sign and type (e.g., Bunting ACSR)		
4	Number of conductors in bundle		
5	Static conductor type #1 (e.g., 24-fiber OPGW)		
6	Static conductor type #2 (e.g., 3/8 EHS)		
7	Average line pole height above ground		feet
8	Transmission structure construction (e.g., H-Frame)		
9	Phase A: average conductor distance from centerline		feet
10	Phase A: average conductor height above ground		feet
11	Phase B: average conductor distance from centerline		feet
12	Phase B: average conductor height above ground		feet
13	Phase C: average conductor distance from centerline		feet
14	Phase C: average conductor height above ground		feet
15	Static #1: average conductor distance from centerline		feet
16	Static #1: average conductor height above ground		feet
17	Static #2: average conductor distance from centerline		feet
18	Static #2: average conductor height above ground		feet
19	Phase conductor mid-span sag		feet
20	Static conductor mid-span sag		feet
21	DC line resistance at 50°C		ohms/phase
22	Positive sequence resistance (R1)		per-unit on 100 MVA base
23	Positive sequence reactance (X1)		per-unit on 100 MVA base
24	Line charging (B)		per-unit on 100 MVA base
25	Zero sequence resistance (R0)		per-unit on 100 MVA base
26	Zero sequence reactance (X0)		per-unit on 100 MVA base
27	Zero sequence line charging (B0)		per-unit on 100 MVA base
28	Continuous line rating in summer (ambient temperature of 37.7°C)		MVA
29	Eight-hour emergency line rating in summer (ambient temperature of 37.7°C)		MVA

#	Parameter	Data	Units
30	Continuous line rating in winter (ambient temperature of 0.0°C)		MVA
31	Eight-hour emergency line rating in winter (ambient temperature of 0.0°C)		MVA
32	Continuous line rating in spring/fall (ambient temperature of 20.0°C)		MVA
33	Eight-hour emergency line rating in spring/fall (ambient temperature of 20.0°C)		MVA
34	Buswork continuous rating		MVA
35	Buswork eight-hour emergency rating		MVA
36	Jumper continuous rating		MVA
37	Jumper eight-hour emergency rating		MVA
38	Disconnect switch continuous rating		MVA
39	Disconnect switch eight-hour emergency rating		MVA
40	CT set ratios		MVA
41	CT full ratios		MVA
42	CT Thermal Rating Factors		MVA
43	High relay limit		MVA
44	Low relay limit		MVA
45	Wave trap type (air core, epoxy, etc.)		
46	Wave trap continuous rating		MVA
47	Wave trap eight-hour emergency rating		MVA
48	Series shunt resistance		per-unit on 100 MVA base
49	Series shunt reactance		per-unit on 100 MVA base
50	Series shunt continuous rating		MVA
51	Series shunt eight-hour emergency rating		MVA
52	Line is protected by Metal-Oxide Varistor (MOV); yes or no		
53	MOV protection mode (choose one of the following): 1. MOV protection enabled 2. MOV protection disabled 3. Spark-gap protection		
54	MOV rated current		kA
55	MOV continuous rating		MVA
56	MOV eight-hour emergency rating		MVA
57	One-line diagram of the interconnection facility with the above information	(please attach)	

Interconnection Transformer Data

If the Customer owns multiple applicable interconnection transformers, this data request should be populated for all applicable transformers.

Table 28: Required Interconnection Two-Winding Transformer Data (If Applicable)

#	Parameter	Data	Units
1	Primary (H) winding DC resistance corrected to 85°C		ohms/phase
2	Secondary (X) winding DC resistance corrected to 85°C		ohms/phase
3	H-winding has GIC blocking device (yes or no)?		
4	H-winding GIC blocking device is enabled (yes or no)?		
5	X-winding has GIC blocking device (yes or no)?		
6	X-winding GIC blocking device is enabled (yes or no)?		
7	Is auto-transformer (yes or no)?		
8	Transformer core construction: 1. Single-phase bank 2. Three-phase, shell-type 3. Three-phase, core-type (3 legs) 4. Three-phase, core-type (5 legs) 5. Three-phase, core-type (7 legs)		
9	Nominal H-winding phase-to-phase voltage		kV
10	H-winding connection configuration		Grounded-Y, Y, or Δ
11	H-winding fixed tap setting, if present		kV
12	Nominal secondary X-winding phase-to-phase voltage		kV
13	X-winding connection configuration		Grounded-Y, Y, or Δ
14	X-winding Load Tap Changer (LTC) present (yes or no)?		
15	If applicable, number of LTC steps		
16	If applicable, LTC control method (e.g., voltage, real power flow, etc.)		
17	LTC regulation range (plus/minus of nominal)		±%
18	H-winding impedance base		MVA
19	No-load losses at 100% voltage and corrected to 85°C		W
20	No-load exciting current at 100% voltage and corrected to 85°C		%
21	Transformer no-load conductance (G)		per-unit on H-winding MVA base
22	Transformer no-load susceptance (B)		per-unit on H-winding MVA base
23	H-X load losses at nominal tap, corrected to 85°C		W
24	H-X load loss impedance at nominal tap, corrected to 85°C		%

#	Parameter	Data	Units
25	H-X winding positive sequence resistance		per-unit on H-winding MVA base
26	H-X winding positive sequence reactance		per-unit on H-winding MVA base
27	Zero-sequence impedance base		MVA
28	Zero-sequence resistance		%
29	Zero-sequence reactance		%
30	Zero-sequence resistance R01 (if applicable)		per-unit on H-winding MVA base
31	Zero-sequence reactance X01 (if applicable)		per-unit on H-winding MVA base
32	Zero-sequence grounding resistance Rg1 (if applicable)		per-unit on H-winding MVA base
33	Zero-sequence grounding reactance Xg1 (if applicable)		per-unit on H-winding MVA base
34	Zero-sequence resistance R02 (if applicable)		per-unit on H-winding MVA base
35	Zero-sequence reactance X02 (if applicable)		per-unit on H-winding MVA base
36	Zero-sequence grounding resistance Rg2 (if applicable)		per-unit on H-winding MVA base
37	Zero-sequence grounding reactance Xg2 (if applicable)		per-unit on H-winding MVA base
38	Neutral resistance (if applicable)		per-unit on H-winding MVA base
39	Neutral reactance (if applicable)		per-unit on H-winding MVA base
40	Transformer winding temperature rise (55°C, 65°C, or 55/65°C)		
41	Maximum transformer continuous rating		MVA
42	Maximum transformer eight-hour emergency rating		MVA
43	Buswork continuous rating		MVA
44	Buswork eight-hour emergency rating		MVA
45	Jumper continuous rating		MVA
46	Jumper eight-hour emergency rating		MVA
47	Disconnect switch continuous rating		MVA
48	Disconnect switch eight-hour emergency rating		MVA
49	CT set ratios		MVA

#	Parameter	Data	Units
50	CT full ratios		MVA
51	CT Thermal Rating Factors		MVA
52	High relay limit		MVA
53	Low relay limit		MVA
54	Interconnection transformer nameplate(s)	(please attach)	
55	Interconnection transformer test report(s)	(please attach)	

Table 29: Required Interconnection Three-Winding Transformer Data (If Applicable)

#	Parameter	Data	Units
1	Primary (H) winding DC resistance corrected to 85°C		ohms/phase
2	Secondary (X) winding DC resistance corrected to 85°C		ohms/phase
3	Tertiary (Y) winding DC resistance corrected to 85°C		ohms/phase
4	H-winding has GIC blocking device (yes or no)?		
5	H-winding GIC blocking device is enabled (yes or no)?		
6	X-winding has GIC blocking device (yes or no)?		
7	X-winding GIC blocking device is enabled (yes or no)?		
8	Y-winding has GIC blocking device (yes or no)?		
9	Y-winding GIC blocking device is enabled (yes or no)?		
10	Is H-X auto-transformer (yes or no)?		
11	Is H-Y auto-transformer (yes or no)?		
12	Is X-Y auto-transformer (yes or no)?		
13	Transformer core construction: 1. Single-phase bank 2. Three-phase, shell-type 3. Three-phase, core-type (3 legs) 4. Three-phase, core-type (5 legs) 5. Three-phase, core-type (7 legs)		
14	Nominal primary H-winding phase-to-phase voltage		kV
15	H-winding connection configuration		Grounded-Y, Y, or Δ
16	H-winding fixed tap setting, if present		kV
17	Nominal secondary X-winding phase-to-phase voltage		kV
18	X-winding connection configuration		Grounded-Y, Y, or Δ
19	X-winding Load Tap Changer (LTC) present (yes or no)?		
20	If applicable, number of LTC steps		
21	If applicable, LTC control method (e.g., voltage, real power flow, etc.)		
22	LTC regulation range (plus or minus of nominal)		±%
23	Nominal tertiary Y-winding phase-to-phase voltage		kV
24	Y-winding connection configuration		Grounded-Y, Y, or Δ
25	H-winding impedance base		MVA
26	No-load losses at 100% voltage and corrected to 85°C		W
27	No-load exciting current at 100% voltage and corrected to 85°C		%

#	Parameter	Data	Units
28	No-load conductance (G)		per-unit on H-winding MVA base
29	No-load susceptance (B)		per-unit on H-winding MVA base
30	H-X winding impedance base rating		MVA
31	H-X load losses at nominal tap, corrected to 85°C		W
32	H-X load loss impedance at nominal tap, corrected to 85°C		%
33	X-Y winding impedance base rating		MVA
34	X-Y load losses at nominal tap, corrected to 85°C		W
35	X-Y load loss impedance at nominal tap, corrected to 85°C		%
36	H-Y winding impedance base rating		MVA
37	H-Y load losses at nominal tap, corrected to 85°C		W
38	H-Y load loss impedance at nominal tap, corrected to 85°C		%
39	H-X winding positive sequence resistance		per-unit on H-winding MVA base
40	H-X winding positive sequence reactance		per-unit on H-winding MVA base
41	H-Y winding positive sequence resistance		per-unit on H-winding MVA base
42	H-Y winding positive sequence reactance		per-unit on H-winding MVA base
43	X-Y winding positive sequence resistance		per-unit on H-winding MVA base
44	X-Y winding positive sequence reactance		per-unit on H-winding MVA base
45	Zero-sequence impedance base		MVA
46	Zero-Sequence winding 1 resistance (H, H-X, or Z1No)		%
47	Zero-Sequence winding 1 reactance (H, H-X, or Z1No)		%
48	Zero-Sequence winding 2 resistance (X, X-Y, or Z2No)		%
49	Zero-Sequence winding 2 reactance (X, X-Y, or Z2No)		%

#	Parameter	Data	Units
50	Zero-Sequence winding 3 resistance (Y, H-Y, or Z1Ns)		%
51	Zero-Sequence winding 3 reactance (Y, H-Y, or Z1Ns)		%
52	Zero sequence resistance R01 (if applicable)		per-unit on H-winding MVA base
53	Zero sequence reactance X01 (if applicable)		per-unit on H-winding MVA base
54	Zero sequence grounding resistance Rg1 (if applicable)		per-unit on H-winding MVA base
55	Zero sequence grounding reactance Xg1 (if applicable)		per-unit on H-winding MVA base
56	Zero sequence resistance R02 (if applicable)		per-unit on H-winding MVA base
57	Zero sequence reactance X02 (if applicable)		per-unit on H-winding MVA base
58	Zero sequence grounding resistance Rg2 (if applicable)		per-unit on H-winding MVA base
59	Zero sequence grounding reactance Xg2 (if applicable)		per-unit on H-winding MVA base
60	Zero sequence resistance R03 (if applicable)		per-unit on H-winding MVA base
61	Zero sequence reactance X03 (if applicable)		per-unit on H-winding MVA base
62	Zero sequence grounding resistance Rg3 (if applicable)		per-unit on H-winding MVA base
63	Zero sequence grounding reactance Xg3 (if applicable)		per-unit on H-winding MVA base
64	Neutral resistance		per-unit on H-winding MVA base
65	Neutral reactance		per-unit on H-winding MVA base
66	Transformer winding temperature rise (55°C, 65°C, or 55/65°C)		
67	H-winding maximum continuous rating		MVA
68	H-winding maximum eight-hour emergency rating		MVA
69	X-winding maximum continuous rating		
70	X-winding maximum eight-hour emergency rating		
71	Y-winding maximum continuous rating		

#	Parameter	Data	Units
72	Y-winding maximum eight-hour emergency rating		
73	Buswork continuous rating		MVA
74	Buswork eight-hour emergency rating		MVA
75	Jumper continuous rating		MVA
76	Jumper eight-hour emergency rating		MVA
77	Disconnect switch continuous rating		MVA
78	Disconnect switch eight-hour emergency rating		MVA
79	CT set ratios		MVA
80	CT full ratios		MVA
81	CT Thermal Rating Factors		MVA
82	High relay limit		MVA
83	Low relay limit		MVA
84	Interconnection transformer nameplate(s)	(please attach)	
85	Interconnection transformer test report(s)	(please attach)	

Table 30: Required Interconnection Transformer Dynamic Saturation Model (If Applicable)

#	Data Requested	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Shunt Reactive Compensation Device Data

If the Customer owns multiple applicable shunt reactive devices, this data request should be populated for all applicable devices.

Table 31: Required Shunt Reactive Device Data

#	Parameter	Data	Units
1	Is SVC (yes or no)?		
2	Is STATCOM (FACTS) device (yes or no)?		
3	Is non-SVC switched capacitor and/or reactor bank (yes or no)?		
4	Number of capacitive steps		
5	Size of each capacitive step		MVAR
6	Number of reactive steps		
7	Size of each reactive step		MVAR
8	Voltage control method (manual or automatic)		
9	Voltage switching levels		per-unit
10	Voltage switching time response for controls		seconds
	Voltage switching control loop		
11	If SVC, STATCOM, or D-SMES, provide: Manufacturer Manufacturer Contact Technical and Operating data	(please attach)	
	DC resistance		ohms
	Grounding resistance		ohms
	Grounding connection		Grounded-Y, Y, or Δ
12	Other reactive power compensation method (capacitive and inductive ratings)		
48	Other reactive power compensation control method	(please attach)	

#	Parameter	Data	Units
1	Is SVC (yes or no)?		
2	Is STATCOM (FACTS) device (yes or no)?		
3	Is non-SVC switched capacitor and/or reactor bank (yes or no)?		
4	Number of capacitive steps		
5	Size of each capacitive step		MVAR
6	Number of reactive steps		
7	Size of each reactive step		MVAR
8	Voltage control method (manual or automatic)		
9	Voltage switching levels		per-unit
10	Voltage switching time response for controls		seconds
11	Voltage switching control loop		
12	If SVC, STATCOM, or D-SMES, provide: Manufacturer Manufacturer Contact Technical and Operating data	(please attach)	
13	DC resistance		ohms

14	Grounding resistance		ohms
15	Grounding connection		Grounded- Y, Y, or Δ
16	Other reactive power compensation method (capacitive and inductive ratings)		
17	Other reactive power compensation control method	(please attach)	

Table 32: Required Dynamic Switched Shunt Model (If Applicable)

#	Data Requested	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 33: Required Dynamic SVC Model (If Applicable)

#	Data Requested	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	

Table 34: Required Dynamic STATCOM Model (If Applicable)

#	Data Requested	Data	Units
1	PSSE Model Library Name		
2	Model Type (Standard or User-Written)		
3	Description		
4	Dynamic Model(s)	(please attach)	